



H:\19290\DWG\19290_P1.dwg, FULL, 8/15/2019 10:09:29 AM, 1:1



PLUMBING GENERAL NOTES	
A. ALL WORK SHALL BE IN ACCORDANCE WITH ALL APPLICABLE RULES AND REGULATIONS OF LOCAL AUTHORITIES.	T. THE DOMESTIC WATER SYSTEM, DRAINAGE SYSTEMS, AND GAS PIPING SYSTEM SHALL BE FLUSHED AND PRESSURE TESTED. THE DOMESTIC WATER SYSTEM SHALL BE PURIFIED.
B. ALL AUTHORITIES HAVING JURISDICTION SHALL BE NOTIFIED AT LEAST THREE WORKING DAYS PRIOR TO COMMENCEMENT OF WORK.	U. DRAINAGE PIPING ABOVE AND BELOW FLOOR SHALL BE SCHEDULE 40 PVC UNLESS OTHERWISE REQUIRED BY CODE. PROVIDE CAST IRON OR OTHER APPROVED MATERIAL ONLY WHEN REQUIRED BY JURISDICTION. CONTRACTOR SHALL CLEARLY IDENTIFY WHAT MATERIAL WAS BID AT THE TIME OF BID SUBMITTAL.
C. ALL PIPING SHALL BE ROUTED IN THE SUSPENDED CEILING SPACE UNLESS OTHERWISE INDICATED. ALL PIPING EXPOSED TO VIEW SHALL BE ROUTED AS HIGH AS POSSIBLE AND TIGHT TO THE UNDERSIDE OF THE STRUCTURAL STEEL.	V. ALL FLOOR DRAINS SHALL BE CONNECTED TO THE SANITARY SEWER SYSTEM.
D. EXPOSED PIPING IN FINISHED AREAS SHALL BE CHROME PLATED WITH CHROME PLATED ESCUTCHEON AT PIPE ENTRY TO FINISHED AREA.	W. THE EXISTING CONDITIONS ARE BASED ON "AS-BUILT" DRAWINGS AND/OR LIMITED FIELD VERIFICATIONS. THE CONTRACTOR SHALL ADJUST TO ACTUAL FIELD CONDITIONS AT NO ADDITIONAL EXPENSE TO THE PROJECT. NO ADDITIONAL COMPENSATION WILL BE PROVIDED FOR ANY EXTRAS DUE TO THE CONTRACTOR'S FAILURE TO VISIT THE PROJECT SITE AND/OR PREDETERMINATION OF EXISTING CONDITIONS PRIOR TO SUBMITTING THE BID. ANY DISCREPANCIES SHALL BE IMMEDIATELY REPORTED TO THE ARCHITECT/ENGINEER FOR RESOLUTION.
E. SLEEVE OR CORE-DRILL FLOOR SLABS, WALLS, ETC. AS REQUIRED FOR PIPING AND FIRE-STOP OPENING AROUND PIPE. VERIFY LOCATION OF STRUCTURAL BEAMS, JOISTS, ETC. BEFORE DRILLING.	X. THE CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH THE INCIDENTAL DEMOLITION WORK PRIOR TO BIDDING AND COMMENCEMENT OF WORK. THE CONTRACTOR IS RESPONSIBLE FOR DEMOLITION OF ALL EXISTING EQUIPMENT AS REQUIRED FOR INSTALLATION/CONSTRUCTION OF NEW WORK.
F. ALL OPENINGS IN DRAINAGE AND/OR VENT SYSTEMS AS A RESULT OF INSTALLATION ROUGH-IN SHALL BE PROTECTED WITH A TEST PLUG THAT IS SECURELY LOCKED IN PLACE UNTIL FINAL FINISHED CONNECTIONS ARE INSTALLED.	Y. COORDINATE ALL SLAB PENETRATIONS WITH GENERAL CONTRACTOR PRIOR TO CONSTRUCTION. MAINTAIN A MINIMUM OF 2" CLEARANCE FROM THE EDGE OF THE SLAB OPENING TO ANY STRUCTURAL MEMBERS AND PIPES.
G. ALL PIPING SHALL BE CONCEALED IN WALLS AND BEHIND FIXED FURNISHINGS UNLESS OTHERWISE INDICATED.	Z. PIPE SIZES INDICATED ON THE PLANS ARE MINIMUM. THE CONTRACTOR SHALL PROVIDE PIPE SIZES EQUAL TO OR GREATER THAN THE SPECIFIED SIZES. THE CONTRACTOR MAY INCREASE PIPE SIZES AS REQUIRED AT NO ADDITIONAL EXPENSE TO THE PROJECT.
H. WHEREVER FOUNDATION WALLS, OUTSIDE WALLS, ROOF, ETC. ARE PENETRATED FOR INSTALLATION OF SYSTEMS, THEY SHALL BE PATCHED TO MATCH EXISTING CONSTRUCTION AND SEALED WEATHER TIGHT. WORK SHALL BE PERFORMED BY CRAFTSMEN SKILLED IN THEIR RESPECTIVE TRADES.	AA. THE CONTRACTOR SHALL OBTAIN A COPY OF THE LANDLORD'S CRITERIA MANUAL PRIOR TO BIDDING. THE TENANT CRITERIA MANUAL REQUIREMENTS SHALL BE INCLUDED IN THE CONTRACTOR CONTRACT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH THE LANDLORD REQUIREMENTS AT NO ADDITIONAL EXPENSE TO THE PROJECT.
I. ALL PIPING SHALL RUN PARALLEL TO BUILDING LINES AND SUPPORTED AND ANCHORED AS REQUIRED TO FACILITATE EXPANSION AND CONTRACTION. ALL PIPING SHALL BE CONCEALED EXCEPT IN UNFINISHED SPACES. INSTALL AS REQUIRED TO MEET ALL CONSTRUCTION CONDITIONS AND TO ALLOW FOR INSTALLATION OF OTHER WORK INCLUDING DUCTS AND ELECTRICAL CONDUIT. AT ALL CONNECTIONS BETWEEN FERROUS PIPING AND NONFERROUS PIPING, PROVIDE AN ISOLATING DIELECTRIC UNION.	AB. PROVIDE TEMPORARY COVERS, CAPS, OR PLUGS ON SANITARY SEWER SYSTEM THROUGHOUT THE DURATION OF CONSTRUCTION. RAG WADS, DUCT TAPE, OR OTHER SIMILAR METHODS OF TEMPORARY COVERS SHALL NOT BE UTILIZED. UPON COMPLETION OF CONSTRUCTION, COMPLETELY REMOVE ANY AND ALL OBSTRUCTIONS INSIDE THE ENTIRE SYSTEM BY SNAKING, RODING, OR JETTING THE SYSTEM IMMEDIATELY PRIOR TO PROJECT TURNOVER TO THE OWNER.
J. PROVIDE ALL FITTINGS, ACCESSORIES, OFFSETS, AND MATERIALS NECESSARY TO FACILITATE THE PLUMBING SYSTEM'S FUNCTIONING AS INDICATED BY THE DESIGN AND THE EQUIPMENT INDICATED.	AC. ALL BELOW GRADE SANITARY LINES SHALL BE A MINIMUM OF 2" OR IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS.
K. PROVIDE A COMPLETE SYSTEM OF COPPER OR STEEL (OR DWV PVC IF ALLOWED BY CODE) VENT RISERS ABOVE FLOOR. ALL VENTS SHALL BE CARRIED THROUGH THE ROOF WITH FLASHING.	AD. SANITARY TEE FITTINGS SHALL NOT BE INSTALLED IN DRAIN WASTE, AND VENT (DWV) SYSTEM.
L. CONDENSATE AND INDIRECT DRAIN PIPING SHALL BE TYPE "M" COPPER TUBING.	AE. INSTALL SANITARY PIPING 2" OR SMALLER AT A SLOPE OF 1/4" PER FOOT AND SANITARY PIPING LARGER THAN 2" AT A SLOPE OF 1/8" PER FOOT.
M. PROVIDE CLEANOUTS AT THE END OF EACH HORIZONTAL RUN, AND AT THE BASE OF ALL VERTICAL WASTE AND DRAIN PIPES. CLEANOUTS SHALL BE OF THE SAME SIZE AS THE PIPES THEY SERVE.	AF. ALL PUBLIC USE LAVATORY FAUCETS SHALL HAVE AN AUTOMATIC SAFETY WATER MIXING DEVICE IN ACCORDANCE WITH ANSI/ASSE 1016 OR 1017.
N. HOT AND COLD WATER PIPING SHALL BE TYPE L COPPER PIPING ABOVE GRADE AND TYPE "K" COPPER PIPE BELOW GRADE. FITTINGS AS REQUIRED BY LOCAL AUTHORITIES. PROVIDE WATER HAMMER ARRESTORS WADE "SKOKSTOP" MODEL NO. W45 THROUGH W400. SIZE AND LOCATION AS INDICATED BY MANUFACTURER. INSTALL STOP VALVE IN AN ACCESSIBLE LOCATION IN EACH WATER SUPPLY TO EACH FIXTURE. CHECK EXISTING WATER PRESSURE AND PROVIDE PRV WHEN WATER PRESSURE EXCEEDS 80 PSI.	AG. ALL HANDICAPPED ACCESSIBLE WATER CLOSETS SHALL HAVE THE FLUSHING HANDLE ON THE WIDE SIDE OF THE HANDICAPPED ACCESSIBLE STALL AS REQUIRED BY ADA REQUIREMENTS.
O. INSULATE ALL HOT AND COLD WATER PIPING BOTH VERTICALLY AND HORIZONTALLY. IN CEILING BELOW ALL HANDICAPPED FIXTURES AND CONCEALED IN WALLS COMPLETELY. PROVIDE 1" PREFORMED FIBERGLASS AS-J-VB, FLAME SPREAD 25, SMOKE DEVELOPED 50, ASTM C-547.	AH. HARD 90 DEGREE ELBOW WILL NOT BE PERMITTED ON SANITARY LINES.
P. PIPING ROUTED IN EXTERIOR WALLS SHALL BE ROUTED ON WINTER WARM SIDE OF BUILDING WALL INSULATION.	AI. SUPPORT ALL PIPING AND DUCTWORK, EQUIPMENT, ETC. FROM TOP CHORD OF ROOF/FLOOR JOISTS, OR PROVIDE STRUCTURAL CALCULATIONS INDICATING BOTTOM CHORD ATTACHMENT IS ACCEPTABLE.
Q. ACCESS PANELS SHALL BE PROVIDED WHERE CONCEALED CONTROL DEVICES, VALVES, ETC. ARE CONCEALED WITHIN WALLS. WHERE ACCESS FOR ADJUSTMENT AND MAINTENANCE IS POSSIBLE THROUGH LAY-IN SUSPENDED CEILINGS, ACCESS PANELS ARE NOT REQUIRED.	AJ. PLUMBING CONTRACTOR SHALL VERIFY EXISTING WATER PRESSURE AND PROVIDE PRESSURE REDUCING VALVE ON WATER SERVICE IF PRESSURE EXCEEDS 80 PSI.
R. TEST WATER SYSTEM UNDER 150 PSIG HYDROSTATIC PRESSURE, FOR FOUR (4) HOURS MINIMUM. WHEN TESTING INDICATES MATERIALS OR WORKMANSHIP IS DEFICIENT, REPLACE OR REPAIR AS REQUIRED, AND REPEAT TEST UNTIL STANDARDS ARE ACHIEVED.	AK. PROVIDED MEANS FURNISH AND INSTALL.
S. PROVIDE A COMPLETE NATURAL GAS PIPING SYSTEM AS NOTED ON THE DRAWINGS. PIPE AND FITTINGS SHALL BE AS REQUIRED BY LOCAL AUTHORITIES. PROVIDE ALL UNIONS, SHUT-OFF VALVES AND DIRT LEGS REQUIRED BY NFPA-64 AND GOVERNING LOCAL CODES. PROVIDE ALL TESTS, METERS, INSPECTIONS, HANGERS AND EQUIPMENT CONNECTIONS REQUIRED FOR A COMPLETE AND OPERATING SYSTEM. PAINT PIPING ON ROOF WITH TWO COATS OF RUST RESISTANT OUTDOOR PAINT.	

FIRE PROTECTION GENERAL NOTES	
1. PROVIDE ALTERATIONS AND MODIFICATIONS AS NECESSARY TO FURNISH AND INSTALL COMPLETE FIRE PROTECTION SYSTEM PER NFPA #13. THE SYSTEM SHALL COMPLY WITH ALL REQUIREMENTS OF LOCAL, STATE AND FEDERAL AUTHORITIES AND LANDLORD'S INSURING AGENCY.	
2. ALL WORK SHALL BE IN ACCORDANCE WITH THE RULES AND REGULATIONS OF THE LOCAL FIRE PROTECTION DISTRICT AND WATER DEPARTMENT.	
3. ALL AUTHORITIES HAVING JURISDICTION SHALL BE NOTIFIED AT LEAST THREE (3) WORKING DAYS PRIOR TO COMMENCEMENT OF WORK.	
4. PROVIDE AN AUTOMATIC WET PIPE SPRINKLER SYSTEM INCLUDING PIPING, HANGERS, VALVES, ALARMS, SUPPORTS AND SPRINKLER HEADS, NECESSARY AND AS REQUIRED FOR INSTALLATION OF COMPLETE AND APPROVED FIRE PROTECTION SYSTEMS.	
5. WORK SHALL BE PERFORMED BY AN APPROVED AUTOMATIC FIRE PROTECTION SPRINKLER CONTRACTOR. SHOP DRAWINGS AND CALCULATIONS SHALL BE PREPARED BY A REGISTERED PROFESSIONAL ENGINEER. APPROVED CONTRACTOR AND THE CONTRACTOR'S REGISTERED ENGINEER SHALL BE LICENSED WITH THE PROPER AUTHORITIES FOR THE LOCATION OF THIS PROJECT.	
6. PROVIDE A COMPLETE WET PIPE SPRINKLER SYSTEM FOR ALL AREAS, UNLESS OTHERWISE INDICATED OR REQUIRED FOR FREEZE PROTECTION.	
7. SPECIAL CONSIDERATION SHALL BE GIVEN TO AREAS THROUGHOUT THE BUILDING SUCH AS DROPPED SOFFITS, LIGHTING SOFFITS AND RECESSED STORAGE RACKS THAT NECESSITATE ADDITIONAL SPRINKLER HEADS.	
8. RUN PIPING HORIZONTALLY AND AT RIGHT ANGLES TO WALLS AND CEILINGS.	
9. FIRE PROTECTION SYSTEM SHOP DRAWINGS SHALL INCLUDE SEPARATE AND COMPLETE REFLECTED CEILING PLANS INDICATING LOCATION OF EACH SPRINKLER HEAD AS WELL AS PIPING LAYOUTS.	
10. PROVIDE MAIN DRAINS AND AUXILIARY DRAINS WHERE NECESSARY.	
11. PROVIDE TEST CONNECTIONS AT MOST REMOTE POINT OF MAIN PORTION OF EACH SPRINKLER SYSTEM.	
12. FIRE PROTECTION CONTRACTOR SHALL FIELD VERIFY EXACT REQUIREMENTS FOR BUILDING REGARDING PIPE SIZES, ADEQUATE PRESSURES, SERVICE LOCATIONS, ZONING AND SUBMIT SHOP DRAWINGS TO THE AUTHORITIES FOR APPROVAL PRIOR TO FABRICATION OR INSTALLATION OF FIRE PROTECTION WATER SERVICE AND SYSTEMS.	
13. AUTOMATIC SPRINKLERS SHALL BE OF THE OPERATING TEMPERATURE AS REQUIRED BY THE LOCATION WITH SPECIAL REGARD FOR HEATING UNITS. SPRINKLER PIPING SHALL ROUTE AROUND, PROVIDE PROPER CLEARANCES, AND AVOID CONFLICT WITH BUILDING EQUIPMENT AND SYSTEMS.	
14. ALL PIPING EXPOSED TO VIEW SHALL BE ROUTED AS HIGH AS POSSIBLE AND TIGHT TO THE UNDERSIDE OF THE STRUCTURE.	
15. REFER TO ARCHITECTURAL DRAWINGS OR CONSULT ARCHITECT FOR EXACT LOCATION OF FIXTURES, EQUIPMENT, ETC. AND FINAL FINISHED ELEVATIONS PRIOR TO ANY INSTALLATION WORK.	
16. EXISTING SYSTEMS THAT REQUIRE RELOCATION AND SERVE EXISTING FIXTURES OR EQUIPMENT OR AREAS THAT MUST REMAIN ACTIVE, SHALL BE RELOCATED DURING OWNER SCHEDULED SHUT-DOWNS. TEMPORARY CONNECTIONS AND EXTENSIONS OF REQUIRED SYSTEMS SHALL BE PROVIDED AS NEEDED AND AT THE CONTRACTOR'S EXPENSE.	
17. CONTRACTOR SHALL VISIT THE SITE AND DOCUMENT EXISTING CONDITIONS WITHIN THE LIMITS OF DEMOLITION, PRIOR TO START OF ANY WORK. FORWARD TO ARCHITECT/ENGINEER, FOR REVIEW, ONE (1) COPY OF EQUIPMENT AND SYSTEMS BEING REMOVED BY DEMOLITION WORK AND NEW INSTALLATION WORK. LIMITS OF DEMOLITION AREA SHALL BE AS INDICATED ON DRAWINGS PREPARED BY THE ARCHITECTURAL CONSULTANT.	
18. CAREFULLY REVIEW THE MECHANICAL, PLUMBING, ARCHITECTURAL, STRUCTURAL AND ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL ITEMS TO BE REMOVED, RELOCATED, OR ACCOMMODATED; INCLUDE ALL COSTS IN BASE BID FOR THIS WORK.	
19. DRAINING AND REFILLING OF SYSTEMS AS REQUIRED FOR DEMOLITION AND/OR NEW INSTALLATIONS WORK, SHALL BE THE RESPONSIBILITY OF THIS CONTRACTOR.	
20. REROUTE FIRE SPRINKLER PIPING IF REQUIRED FOR THE NEW SUPPLY AND RETURN AIR DUCTWORK LAYOUT.	
21. ALL SPRINKLERS IN UNFINISHED AREAS TO BE BRASS UPRIGHT TYPE.	
22. MODIFICATIONS TO SPRINKLER BRANCH LINES NEED TO BE TIGHT TO STRUCTURE AS POSSIBLE.	


DRAIN SCHEDULE						
DESIGNATOR	TYPE	SIZE	MANUFACTURER	MODEL NO.	TOP FINISH	REMARKS
FCO-1	FLOOR CLEANOUT	SEE PLANS	SMITH	4020	NICKEL BRONZE	VANDAL-PROOF SCREWS; GALVANIZED BODY.

VALVE SCHEDULE				
TYPE	MFR/R.	THREADED/FLANGED PIPING		SOLDERED/ BRAZED PIPING
		2" AND SMALLER	2-1/2" AND LARGER	3" AND SMALLER
GATE	JENKINS	47-C	651-C	1242-C
	MILWAUKEE	148	2885	115
	STOCKHAM	B-100	G-623	B-108
BALL	JENKINS	901A	--	902A
	MILWAUKEE	BA100	--	BA150
	STOCKHAM	S-216-BR1-R-T	--	S-216-BR1-R-S
CHECK	JENKINS	4092	624-C	4093
	MILWAUKEE	509	F2974	1509
	STOCKHAM	B-319	G-931	B-309
AUTOMATIC BALANCING	HAYS	43-45-2510-0.50-P/T	N.A.	N.A.
NOTES: 1. VALVES MATERIAL (BODIES, DISC, GASKETS, LININGS, PACKINGS, ETC.) SHALL BE APPROVED IN WR THE SERVICE IN WHICH THEY ARE INSTALLED. 2. VALVES SHALL BE LINE SIZE UNLESS OTHERWISE INDICATED. 3. VALVES SHALL BE EQUIPPED WITH ACCESSORIES AS REQUIRED.				

PLUMBING SYMBOLS	
— W —	WATER SERVICE
— CWS —	COLD WATER SUPPLY PIPING
— HWS —	HOT WATER SUPPLY PIPING
— TWS —	TEMPERED WATER SUPPLY PIPING
— SAN —	SANITARY DRAINAGE & WASTE PIPING/SEWER
— V —	SANITARY VENT PIPING
— G —	GAS PIPING
— CD —	CONDENSATE PIPING
CB	CAST BRONZE
CP	CHROME PLATED
CO	CLEANOUT
ETR	EXISTING TO REMAIN
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
GALV	GALVANIZED
NC	NEW CONNECTION
S	SANITARY
V	VENT
VTR	VENT THRU ROOF
W	WASTE
	LINE SIZE BALL VALVE (2" & SMALLER) OR LINE SIZE BUTTERFLY VALVE (2-1/2" & LARGER)
	BALANCING VALVE

LANDLORD WORK FOR FUTURE ULTA #1619 2870S. 6TH ST. KLAMATH FALLS, OR 97603		PLUMBING NOTES	
DICKERHOOF CONSTRUCTION P.O. BOX 1800 CORVALLIS, OR 97339		 WGW Engineers, Inc. Wood Dale, IL 60191 Tel. 630.950.1000 www.wgwengineers.com	
Revisions △ ISSUE FOR TENANT REVIEW 08/15/19 △ ISSUE FOR PERMIT 08/15/19 △ △ △ △ △ △			
Signature _____ Date _____ 08/15/2019		I HEREBY CERTIFY THAT THESE PLANS HAVE BEEN PREPARED UNDER MY SUPERVISION AND THAT TO THE BEST OF MY KNOWLEDGE, THE SAME COMPLY WITH ALL RULES, REGULATIONS AND ORDINANCES OF KLAMATH FALLS, OR, RELATING TO STRUCTURES AND BUILDINGS.	
Expiration Date _____ 06/30/2020		ENGINEER _____	
Drawn By _____ QIE		Checked By _____ DH	
Scale _____ 1/16"=1'-0"		Date _____ 08/15/19	
Job No. _____		Sheet No. _____	
		P-1	

HN152301DWG15230_P2.dwg, FULL, 8/15/2019 10:09:43 AM, 1:1

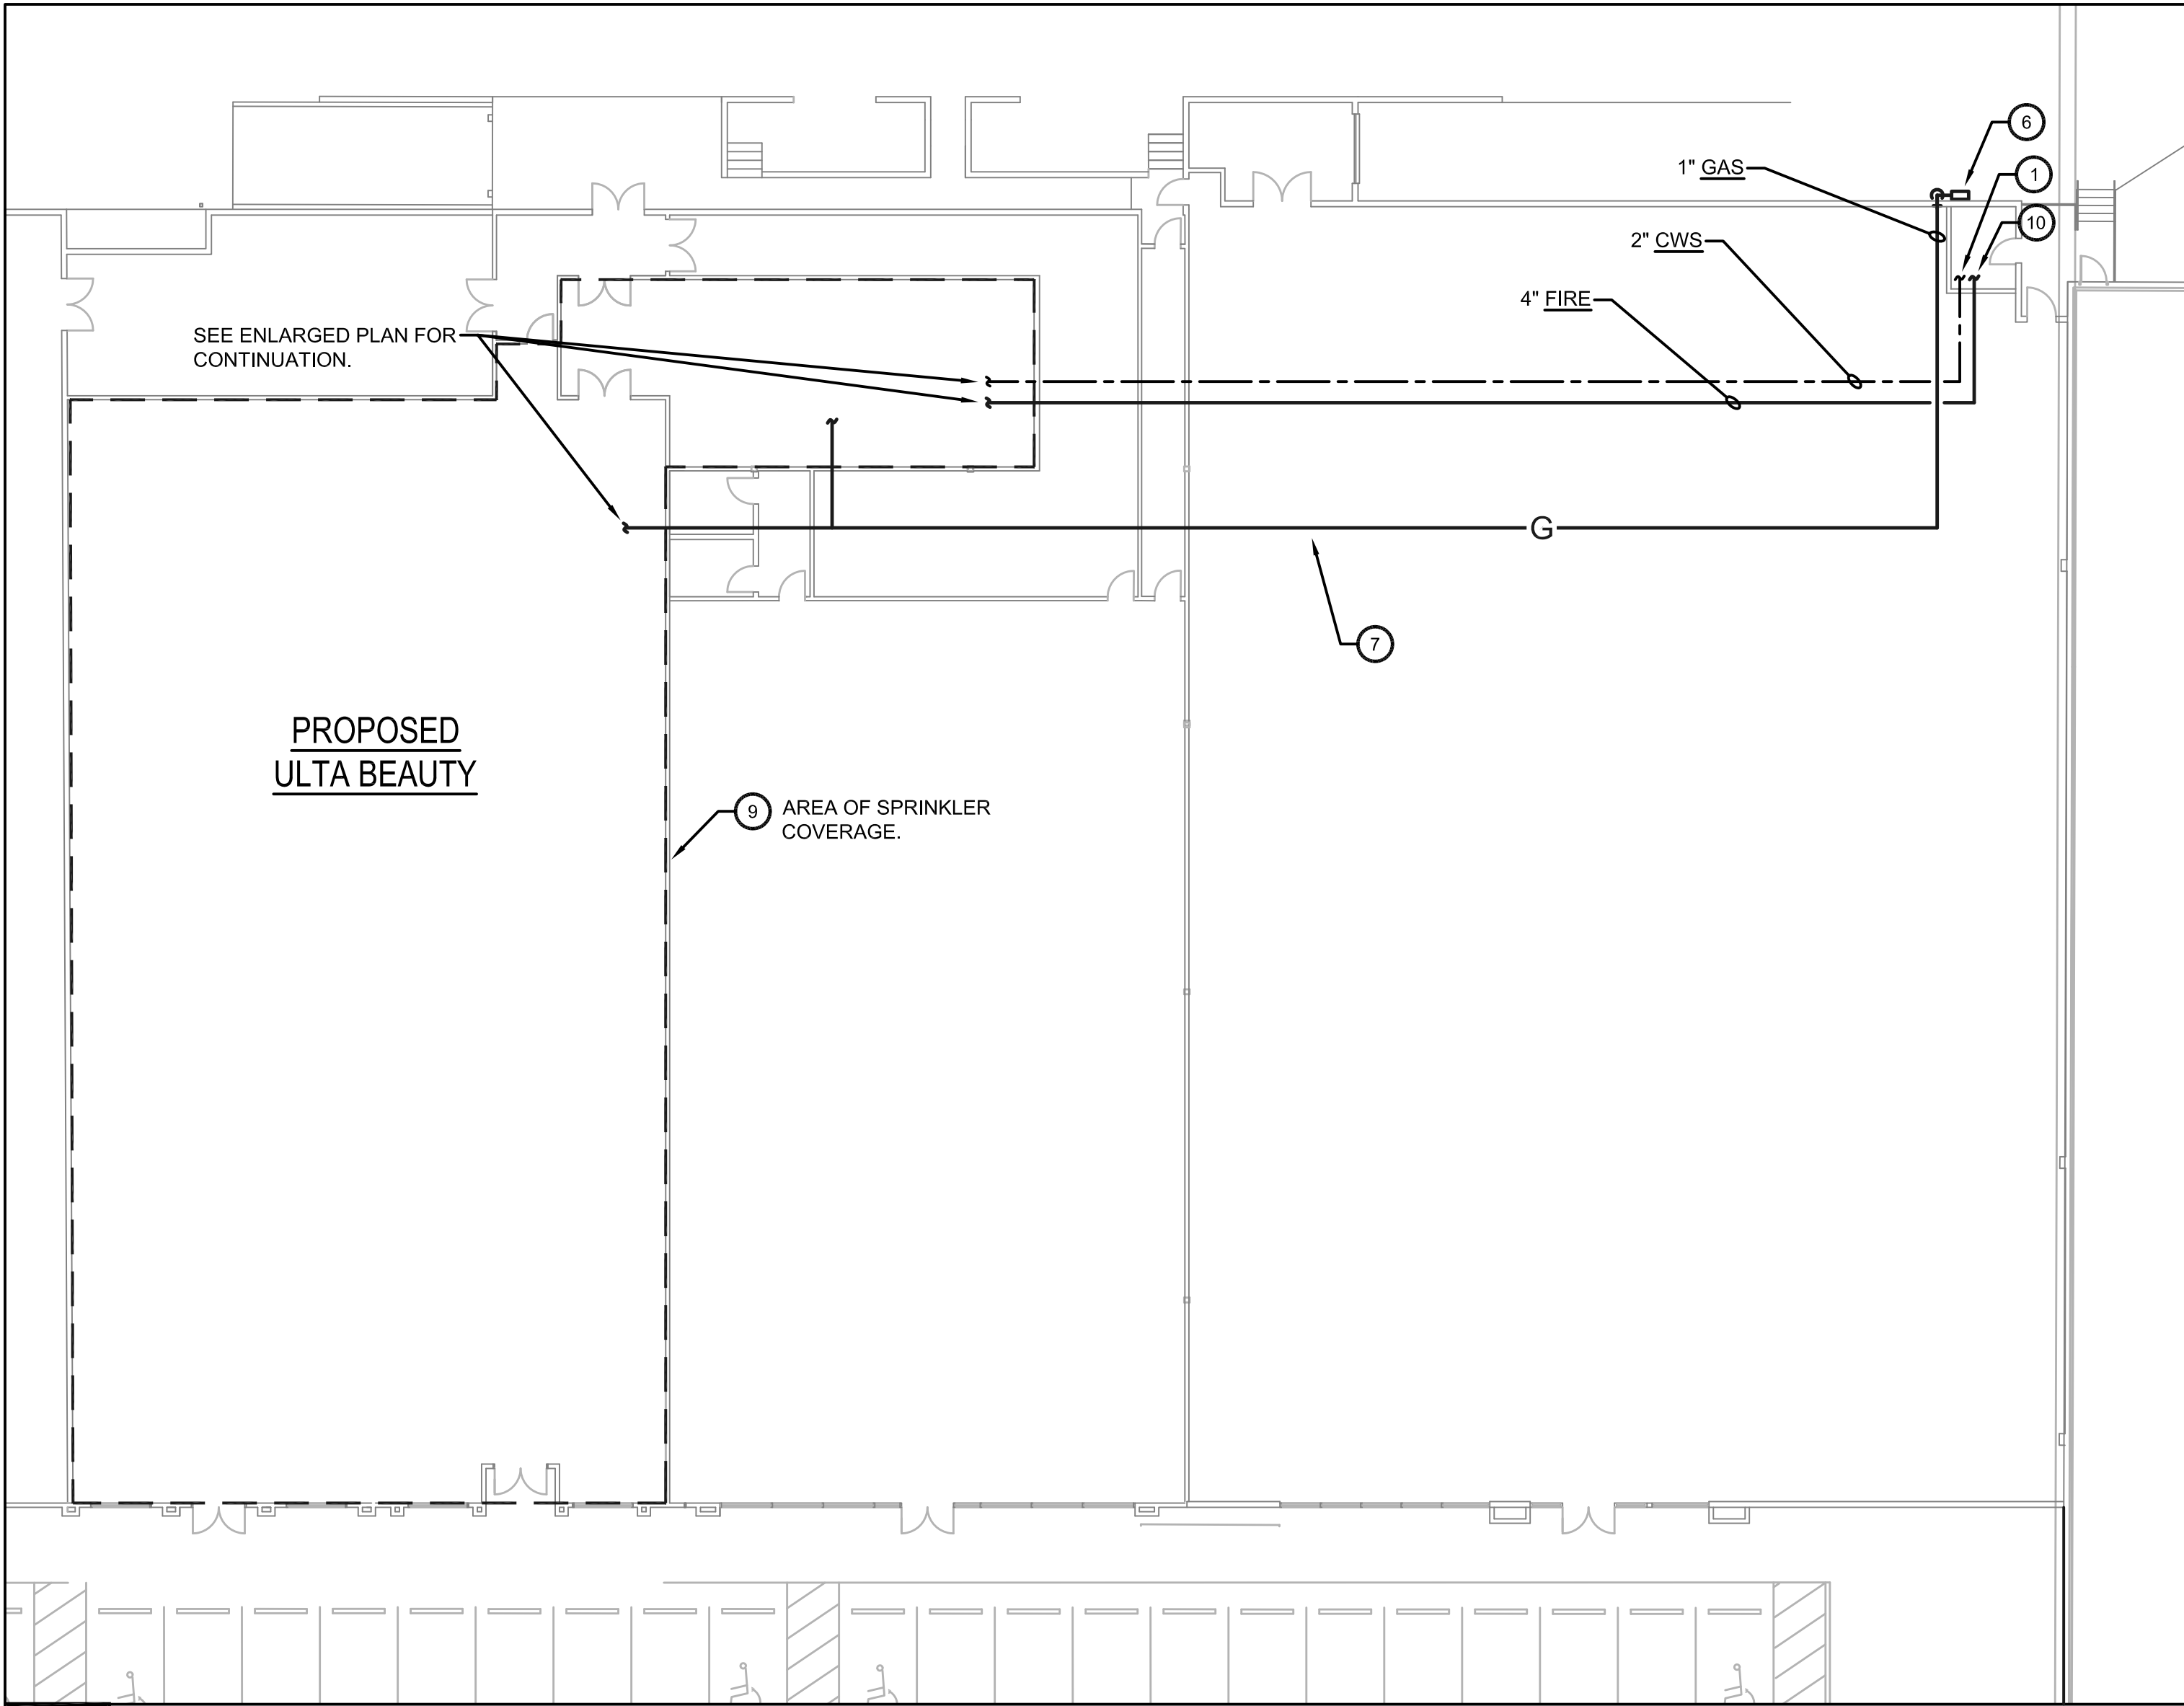


1 OVERALL PLUMBING SITE PLAN

SCALE: 1/32"=1'-0"


PLAN NOTES

- CONNECT NEW 2" CWS TO EXISTING CWS MAIN IN WATER ROOM, PROVIDE NEW CITY APPROVED 1.5" METER WITH REMOTE READER AND CODE REQUIRED BACKFLOW PREVENTER IF NOT EXISTING, PROVIDE 50 GPM FOR FUTURE TENANT, PROVIDE PRV IF REQUIRED BY CODE.
- CONNECT NEW 4" SANITARY PIPE TO EXISTING, FIELD VERIFY EXACT SIZE, LOCATION, AND INVERT OF EXISTING SANITARY PIPING, EXISTING INVERT IS APPROXIMATELY 4' TO 5' DEEP.
- PROVIDE CAPPED 2" CWS WITH SHUT OFF VALVE FOR FUTURE TENANT CONNECTION, EMAIL PRESSURE TO TENANT ARCHITECT WHEN AVAILABLE.
- PROVIDE NEW 4" VTR, TERMINATE 24" BELOW DECK FOR TENANT CONNECTION.
- EXTEND TENANT POINT OF CONNECTION ABOVE FLOOR SLAB, MINIMUM INVERT AT TENANT CONNECTION TO BE 32" BELOW FINISHED FLOOR, EMAIL EXACT INVERT AT POINT OF CONNECTION TO ARCHITECT.
- CONNECT GAS PIPING TO EXISTING GAS METER AT LOCATION OF EXISTING METER BANK, TOTAL GAS LOAD = 654 CFH AT 375 FEET DEVELOPED LENGTH, GAS PIPE SIZED FOR 2 PSI PRESSURE AT 1 PSI PRESSURE DROP, COORDINATE METER AND SERVICE WITH GAS UTILITY.
- GAS PIPING ROUTED ON ROOF, SEE GAS PIPE SUPPORT DETAIL AND GAS PIPING THROUGH ROOF PENETRATIONS DETAIL FOR PIPE PENETRATIONS TO EQUIPMENT ON P-3 SHEET.
- EXISTING FIRE PROTECTION SPRINKLER SERVICE SYSTEM WITH BACKFLOW PREVENTER, FIRE DEPARTMENT CONNECTION, ALARMS, RISER VALVE, ETC. TO REMAIN, ROUTE NEW FIRE MAINS FROM EXISTING SERVICE TO NEW AREA SERVING TENANT AND PROVIDE SPRINKLER SYSTEM COVERAGE AS REQUIRED BY FIRE PREVENTION AUTHORITIES, SEE DETAIL.
- RECONFIGURE EXISTING SPRINKLER SYSTEM AS REQUIRED FOR NEW TENANT AND EXISTING AREAS AND PROVIDE SPRINKLER SYSTEM COVERAGE AS REQUIRED BY FIRE PREVENTION AUTHORITIES.
- PROVIDE 1.25" LOW PRESSURE (7" TO 11" W.C.) GAS FOR 199 CFH FUTURE TENANT WATER HEATER, TERMINATE WITH CAPPED VALVE 24" BELOW DECK.


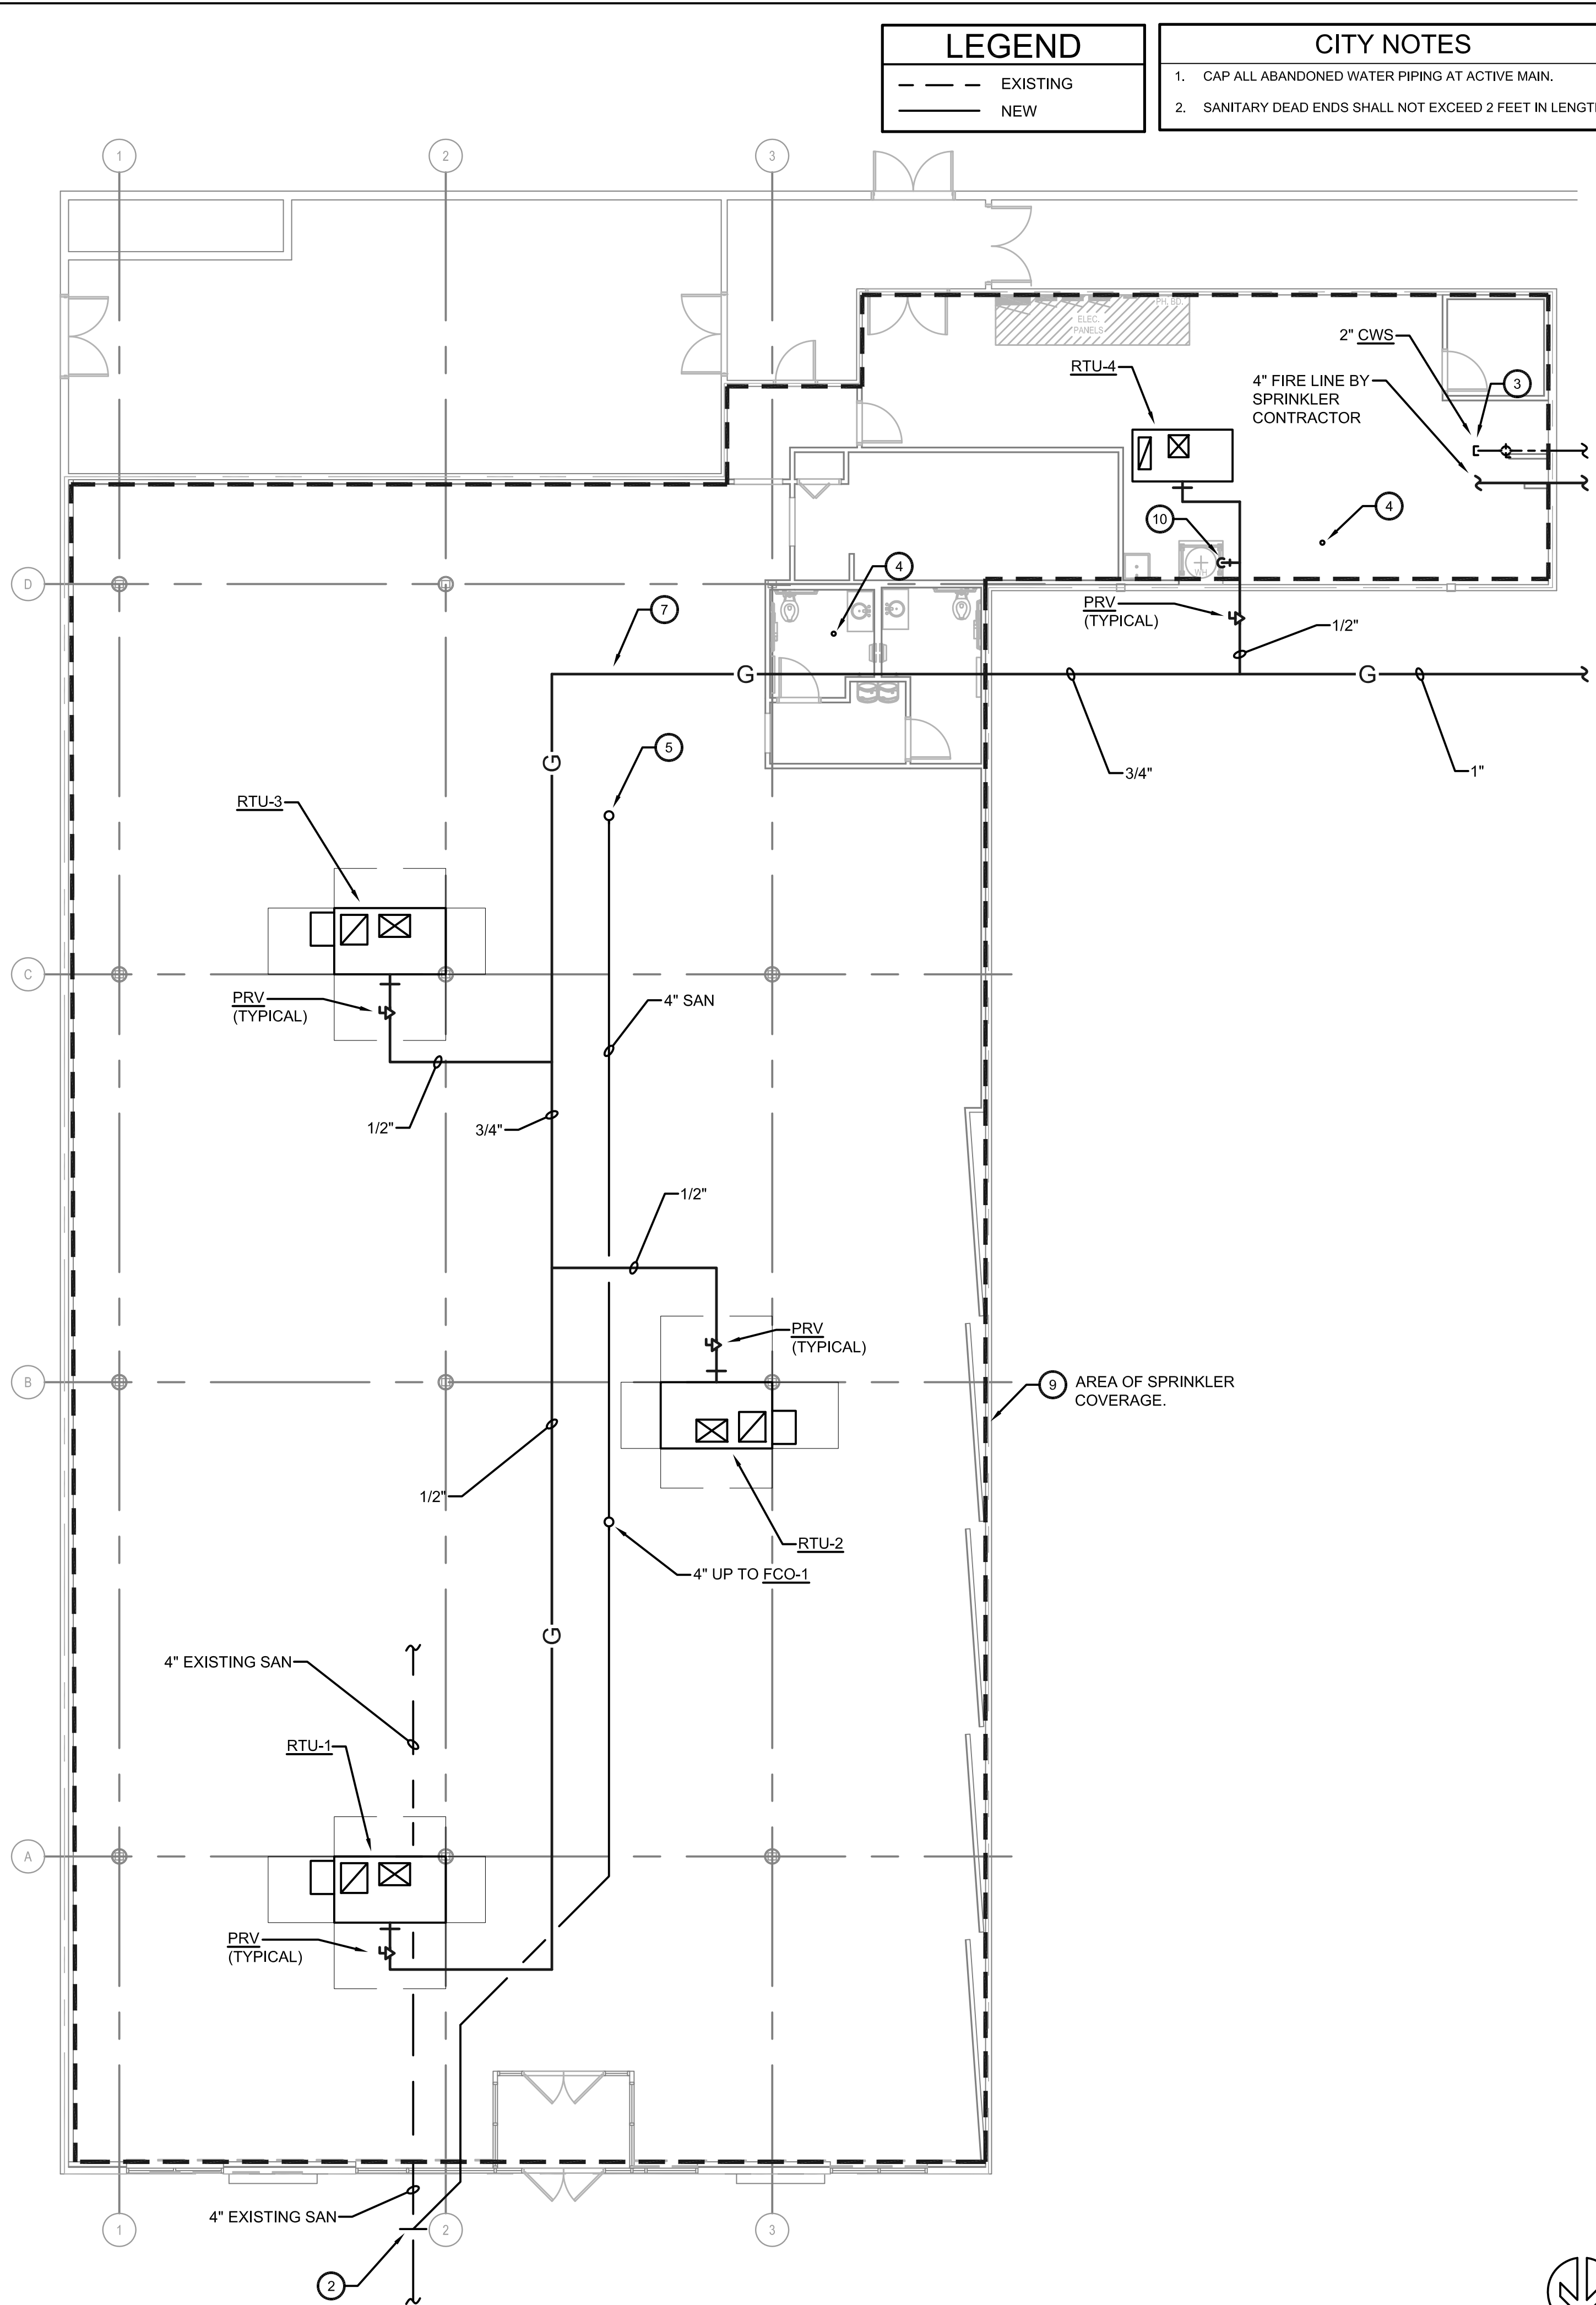


HN19290(DWG)19290_P3.dwg, FULL, 8/15/2019 10:09:49 AM, 1:1


- NOTES:
- PIPE SIZES BASED ON 2 PSI PRESSURE WITH 1 PSI PRESSURE DROP. TOTAL GAS LOAD 654 CFH. TOTAL DEVELOPED LENGTH 375 LF.
 - PAINT ALL EXPOSED GAS PIPING WITH UV RESISTANT PAINT, COLOR BY ARCHITECT.

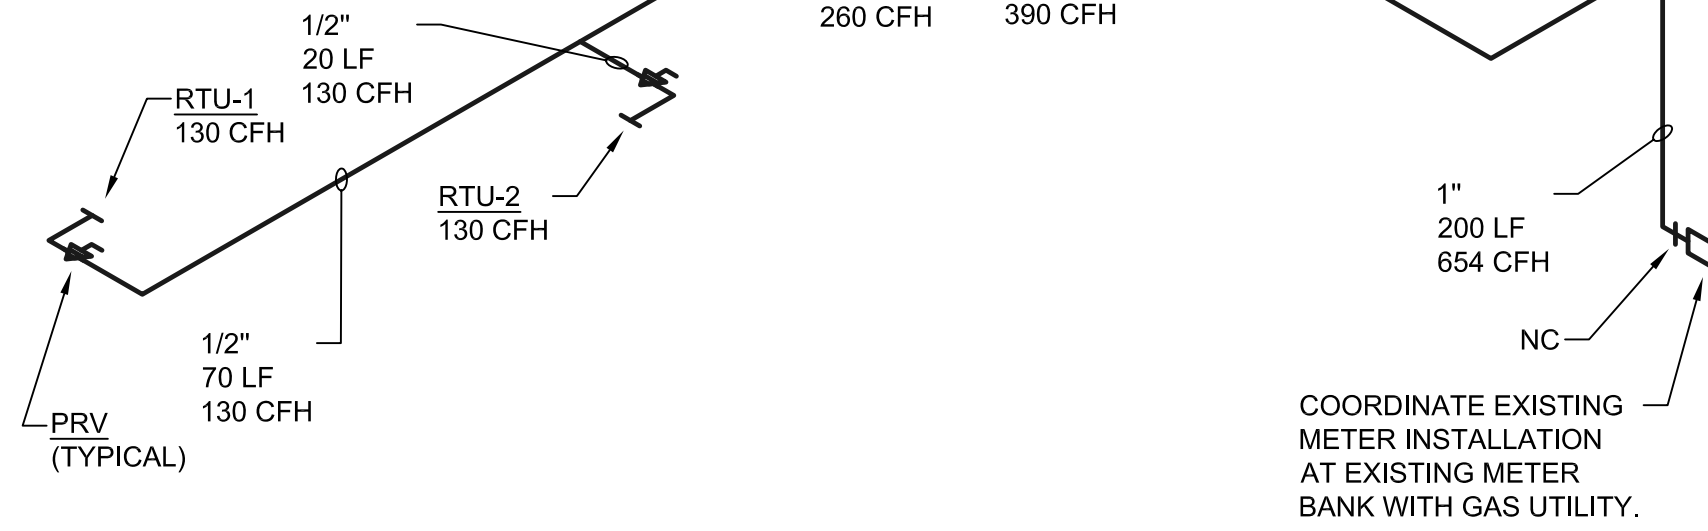


11 GAS ISOMETRIC - ROOF TOP UNITS
NOT TO SCALE

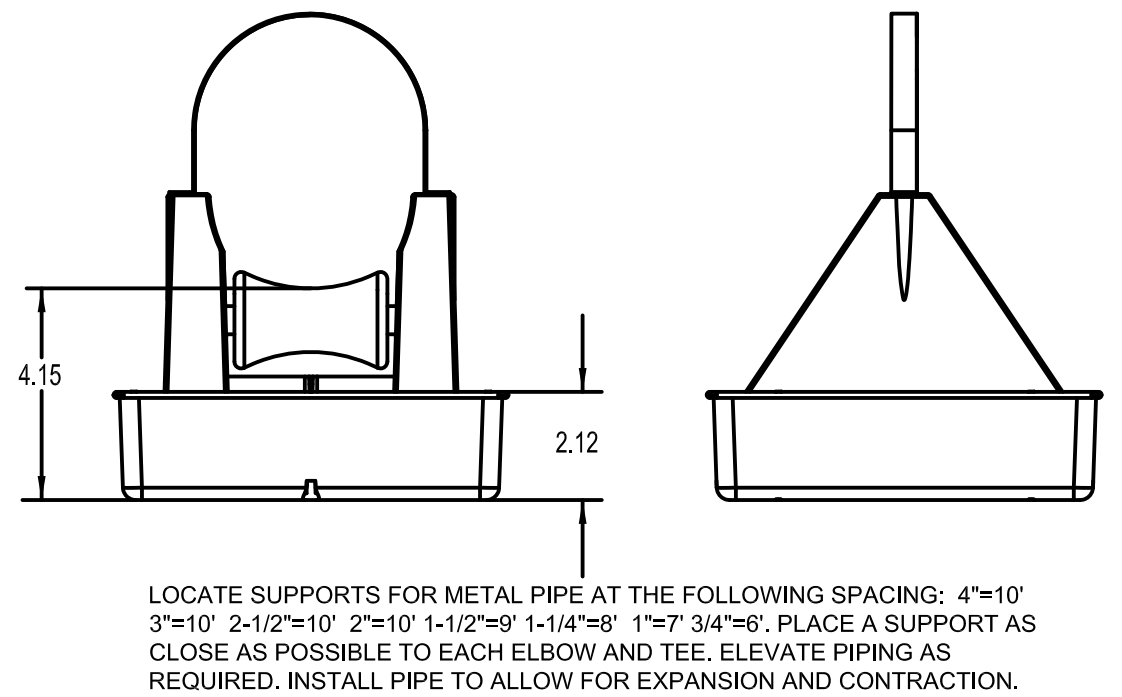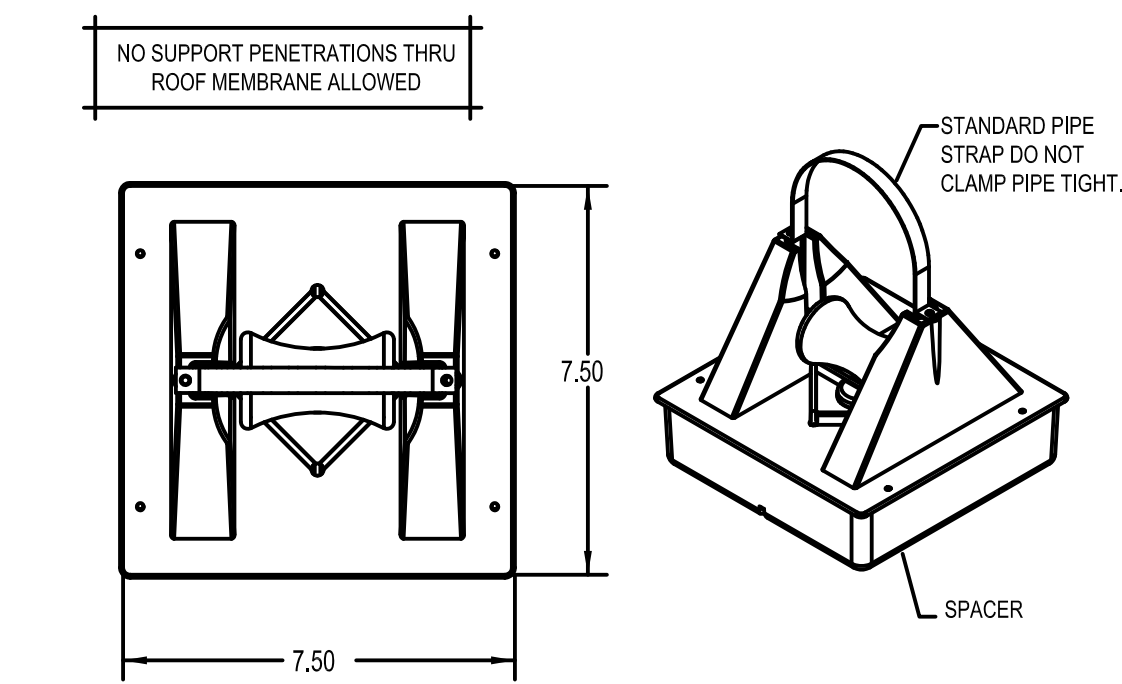

9 PIPE SUPPORT
NOT TO SCALE

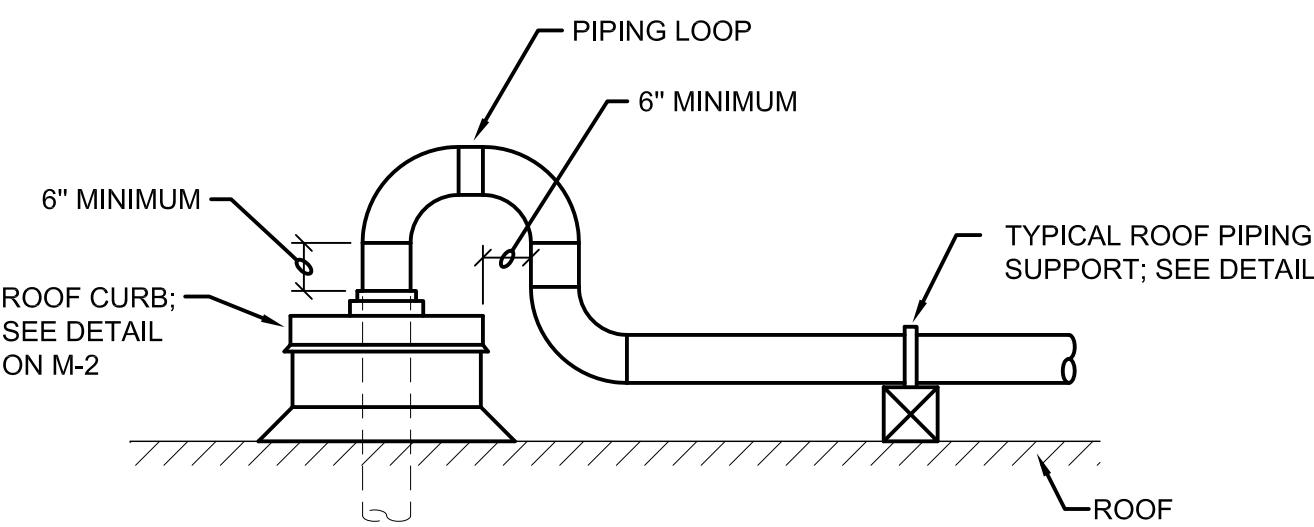


5 GAS PIPING THRU ROOF PENETRATION DETAIL
NOT TO SCALE

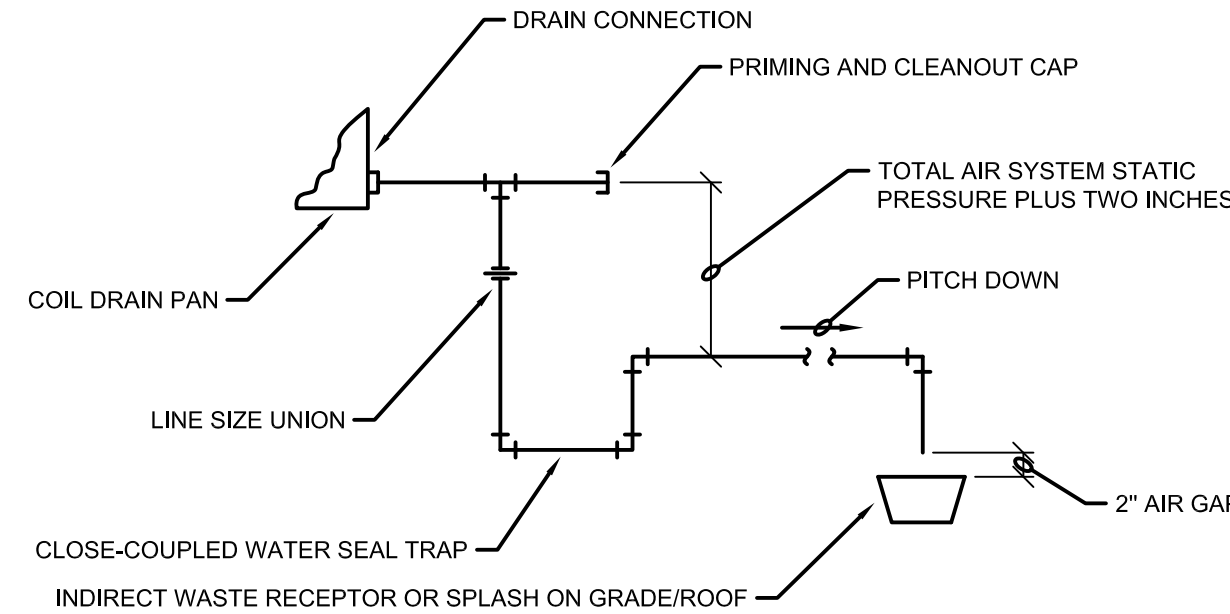


- NOTES:
- SCHEDULE 40, GALVANIZED STEEL PIPE AND FITTINGS.
 - SEE PLANS FOR PIPE SIZES.


6 TYPICAL COIL CONDENSATE DRAIN PIPING DETAIL (DRAW-THRU)
NOT TO SCALE

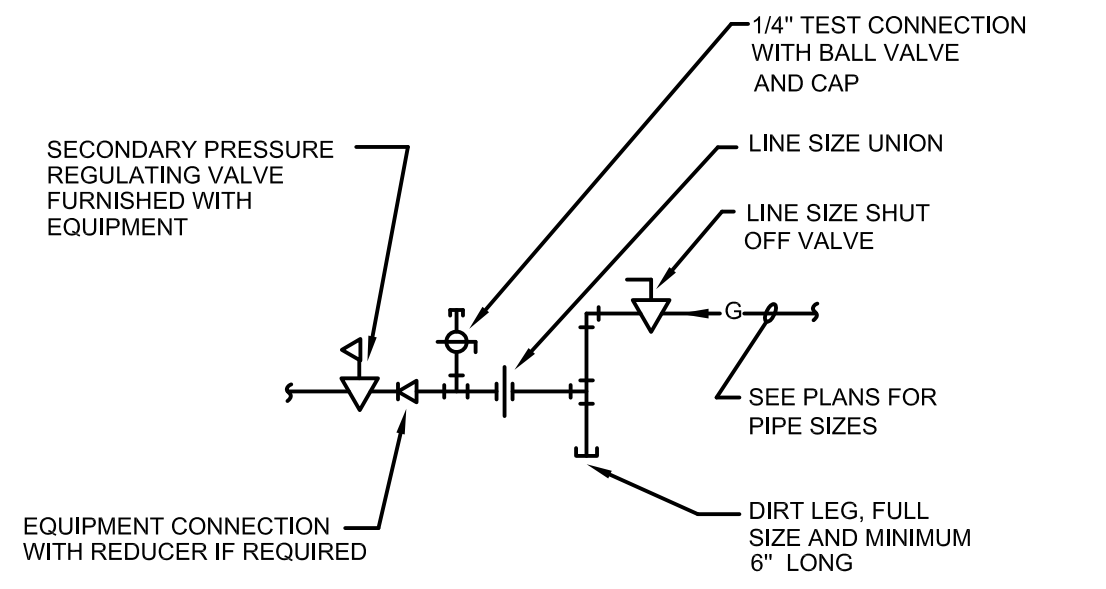


1 TYPICAL GAS PIPING CONNECTION DETAIL
NOT TO SCALE

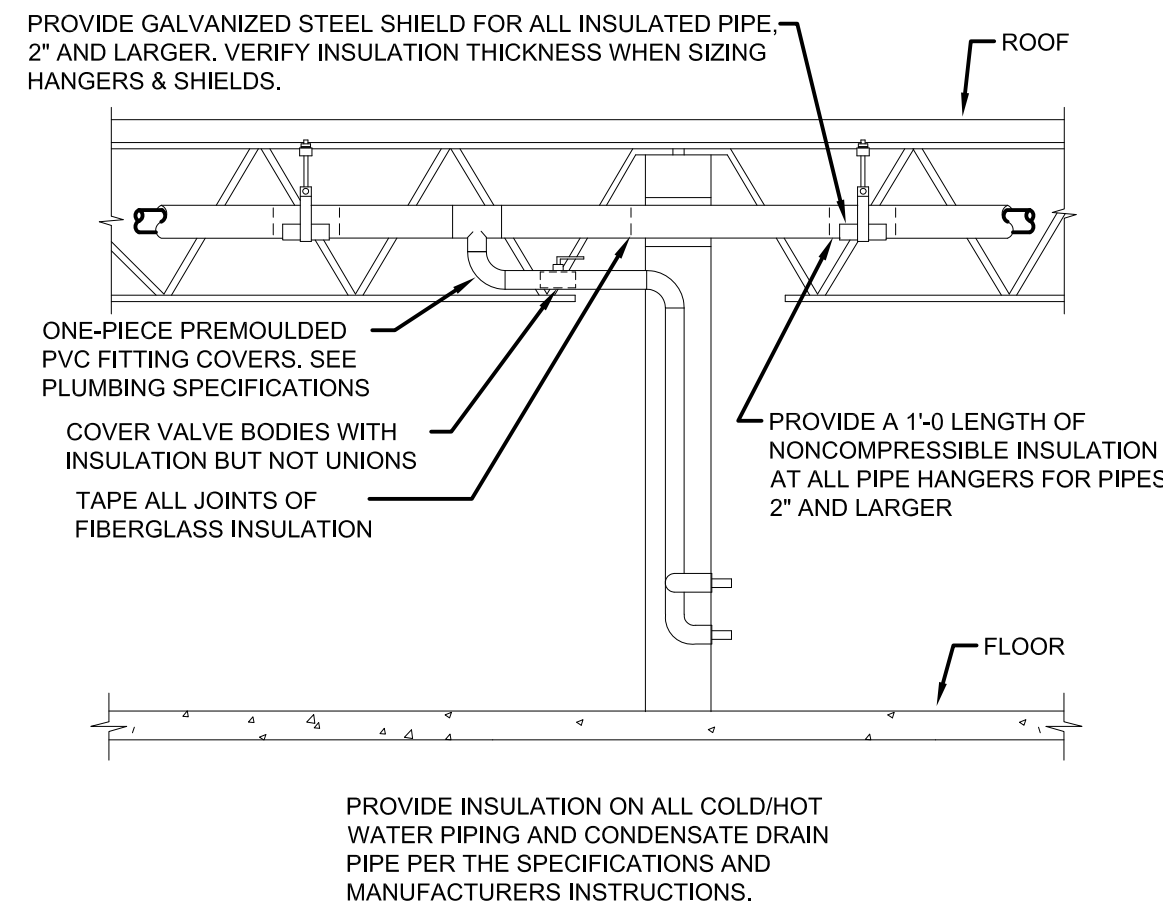


2 PIPE INSULATION DETAIL
NOT TO SCALE

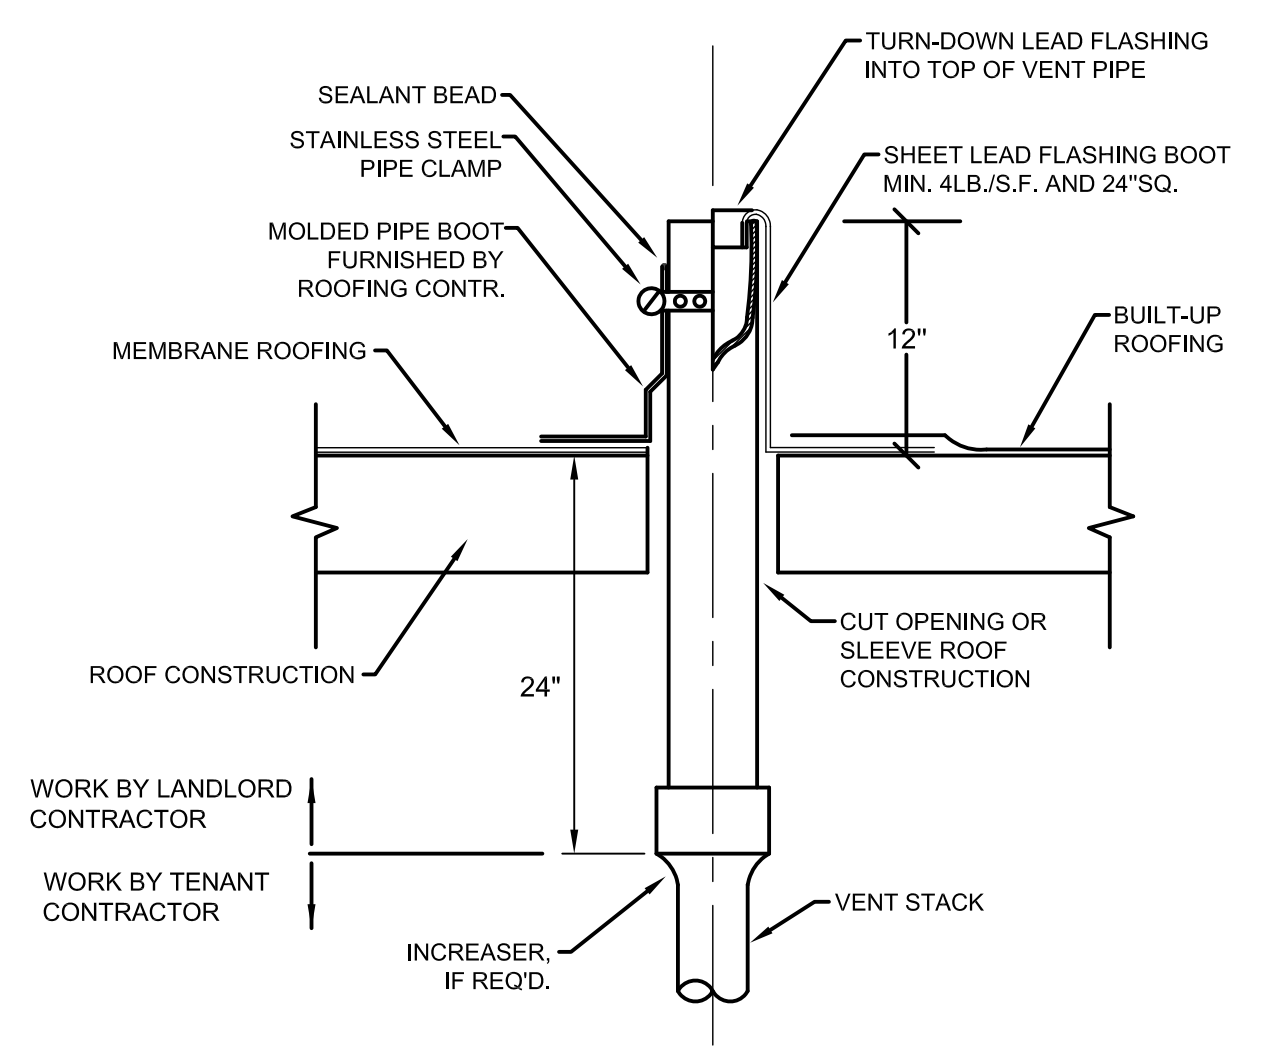


3 VENT THRU ROOF DETAIL
NOT TO SCALE

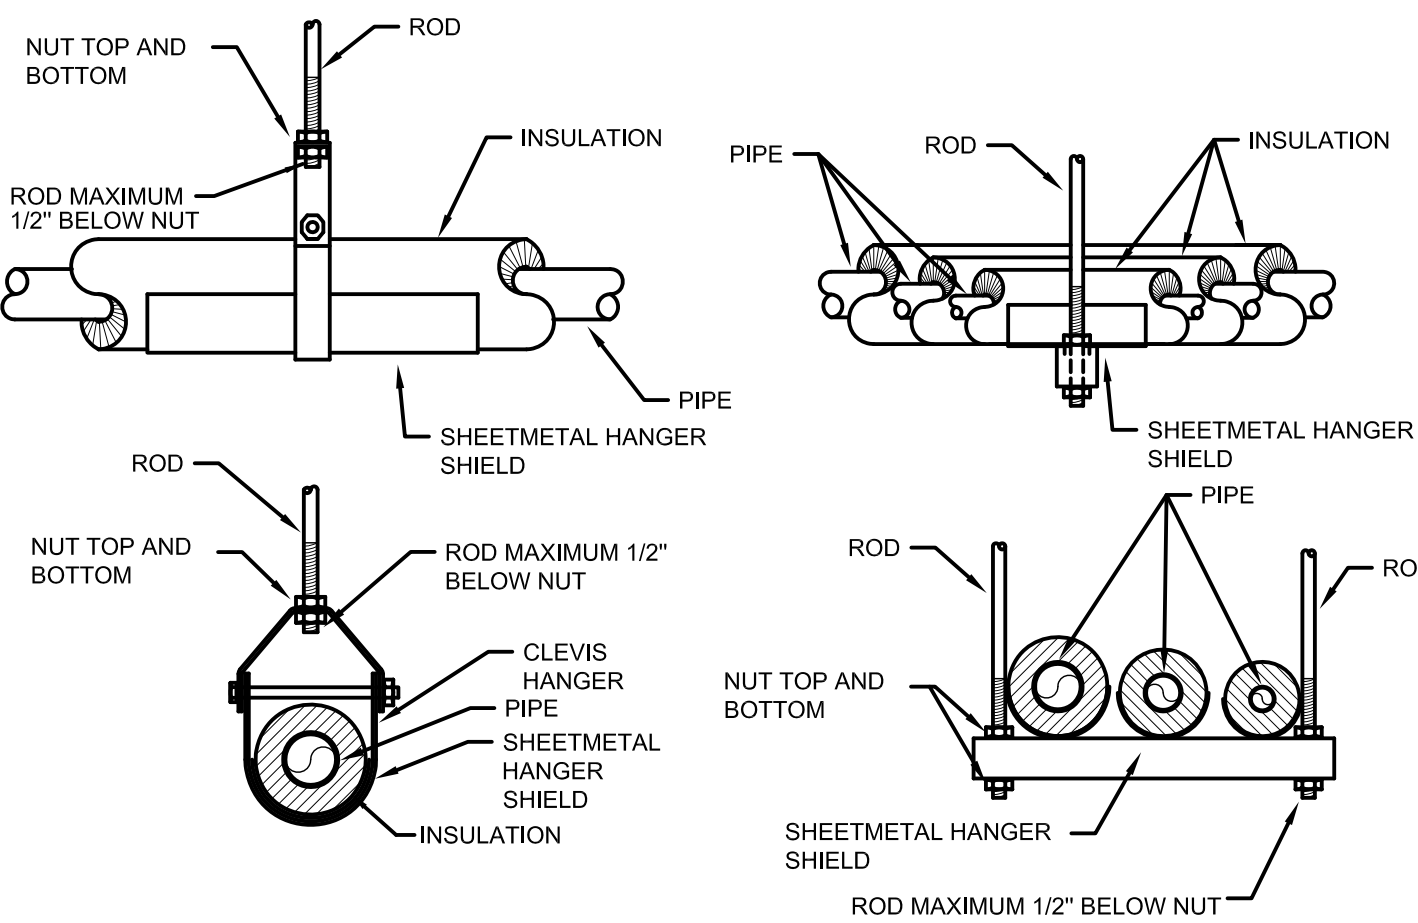

4 TYPICAL HANGER DETAIL
NOT TO SCALE

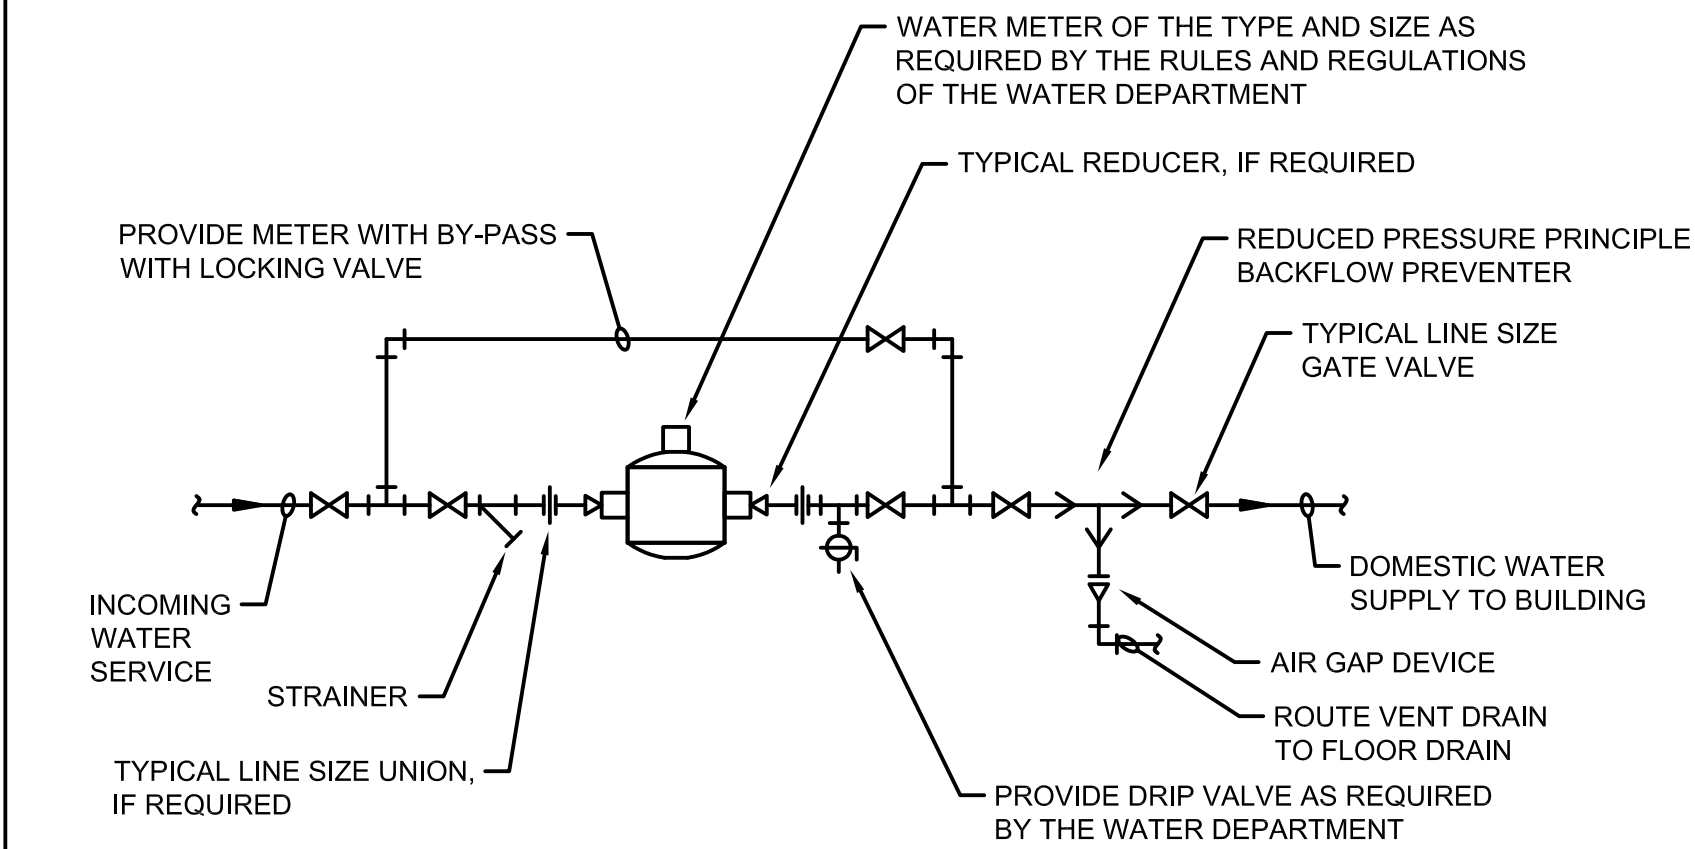


10 WATER METER DETAIL
NOT TO SCALE

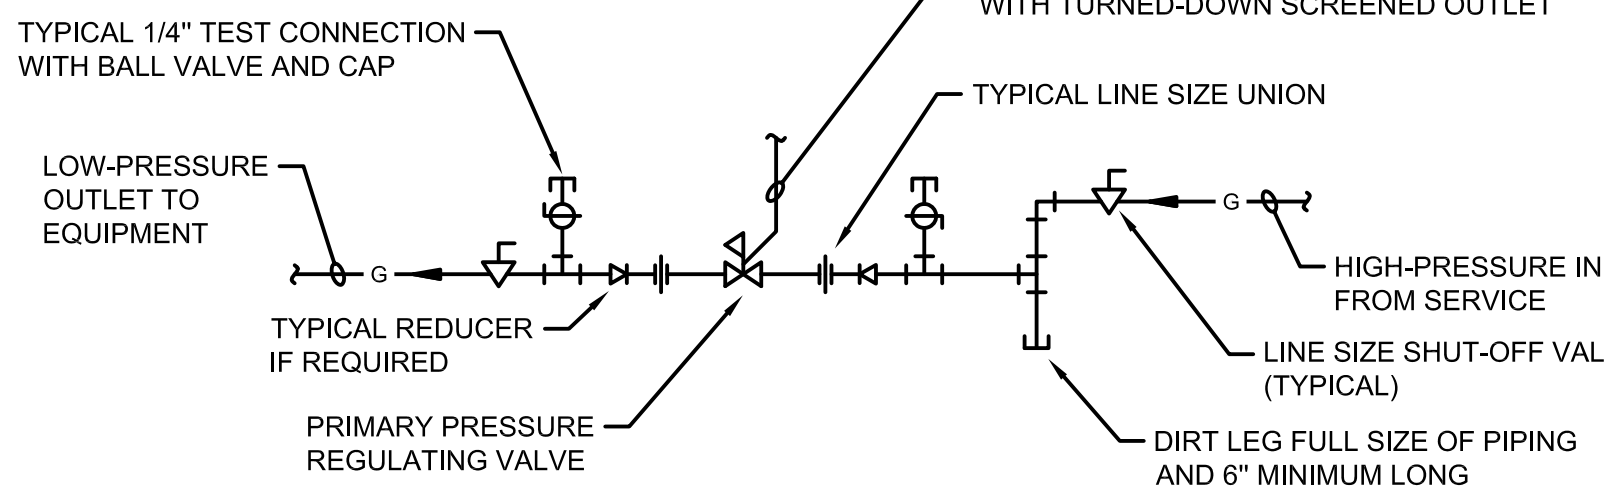

7 TYPICAL GAS PIPING 'PRV' DETAIL
NOT TO SCALE

- LEGEND
- INCOMING FIRE SUPPRESSION SYSTEM WATER SUPPLY.
 - WALL FIRE DEPARTMENT CONNECTION WITH GALVANIZED PIPING AS REQUIRED, VERIFY TYPE, FINISH AND LOCATION WITH AUTHORITIES AND ARCHITECT.
 - DOUBLE DETECTOR OR RPZ CHECK ASSEMBLY AND BY-PASS WITH METER AND DOUBLE DETECTOR OR RPZ CHECK ASSEMBLY AS REQUIRED BY AUTHORITIES.
 - ZONE RISER FLOW SWITCH.
 - ALARM VALVE WITH PRESSURE GAUGES, ETC. AS REQUIRED.
 - MAIN DRAIN VALVE.
 - ALARM BELLS - 6" INSIDE AND 10" OUTSIDE.
 - GALVANIZED PIPE DRAIN LINES TO FLOOR DRAIN; OR THROUGH WALL SPLASH ON GRADE WITH SPLASH BLOCK.
 - SWING-TYPE CHECK VALVE.
 - OS&Y GATE VALVE WITH TAMPER SWITCH.
 - VERTICAL CHECK VALVE.
 - TYPICAL PIPE SUPPORT FLOOR STAND.
 - SPARE SPRINKLERS AND WRENCH WITH WALL CABINET.
 - REMOVE EXISTING FITTINGS AND REPLACE WITH PIPE AND FITTINGS FOR NEW RISERS.

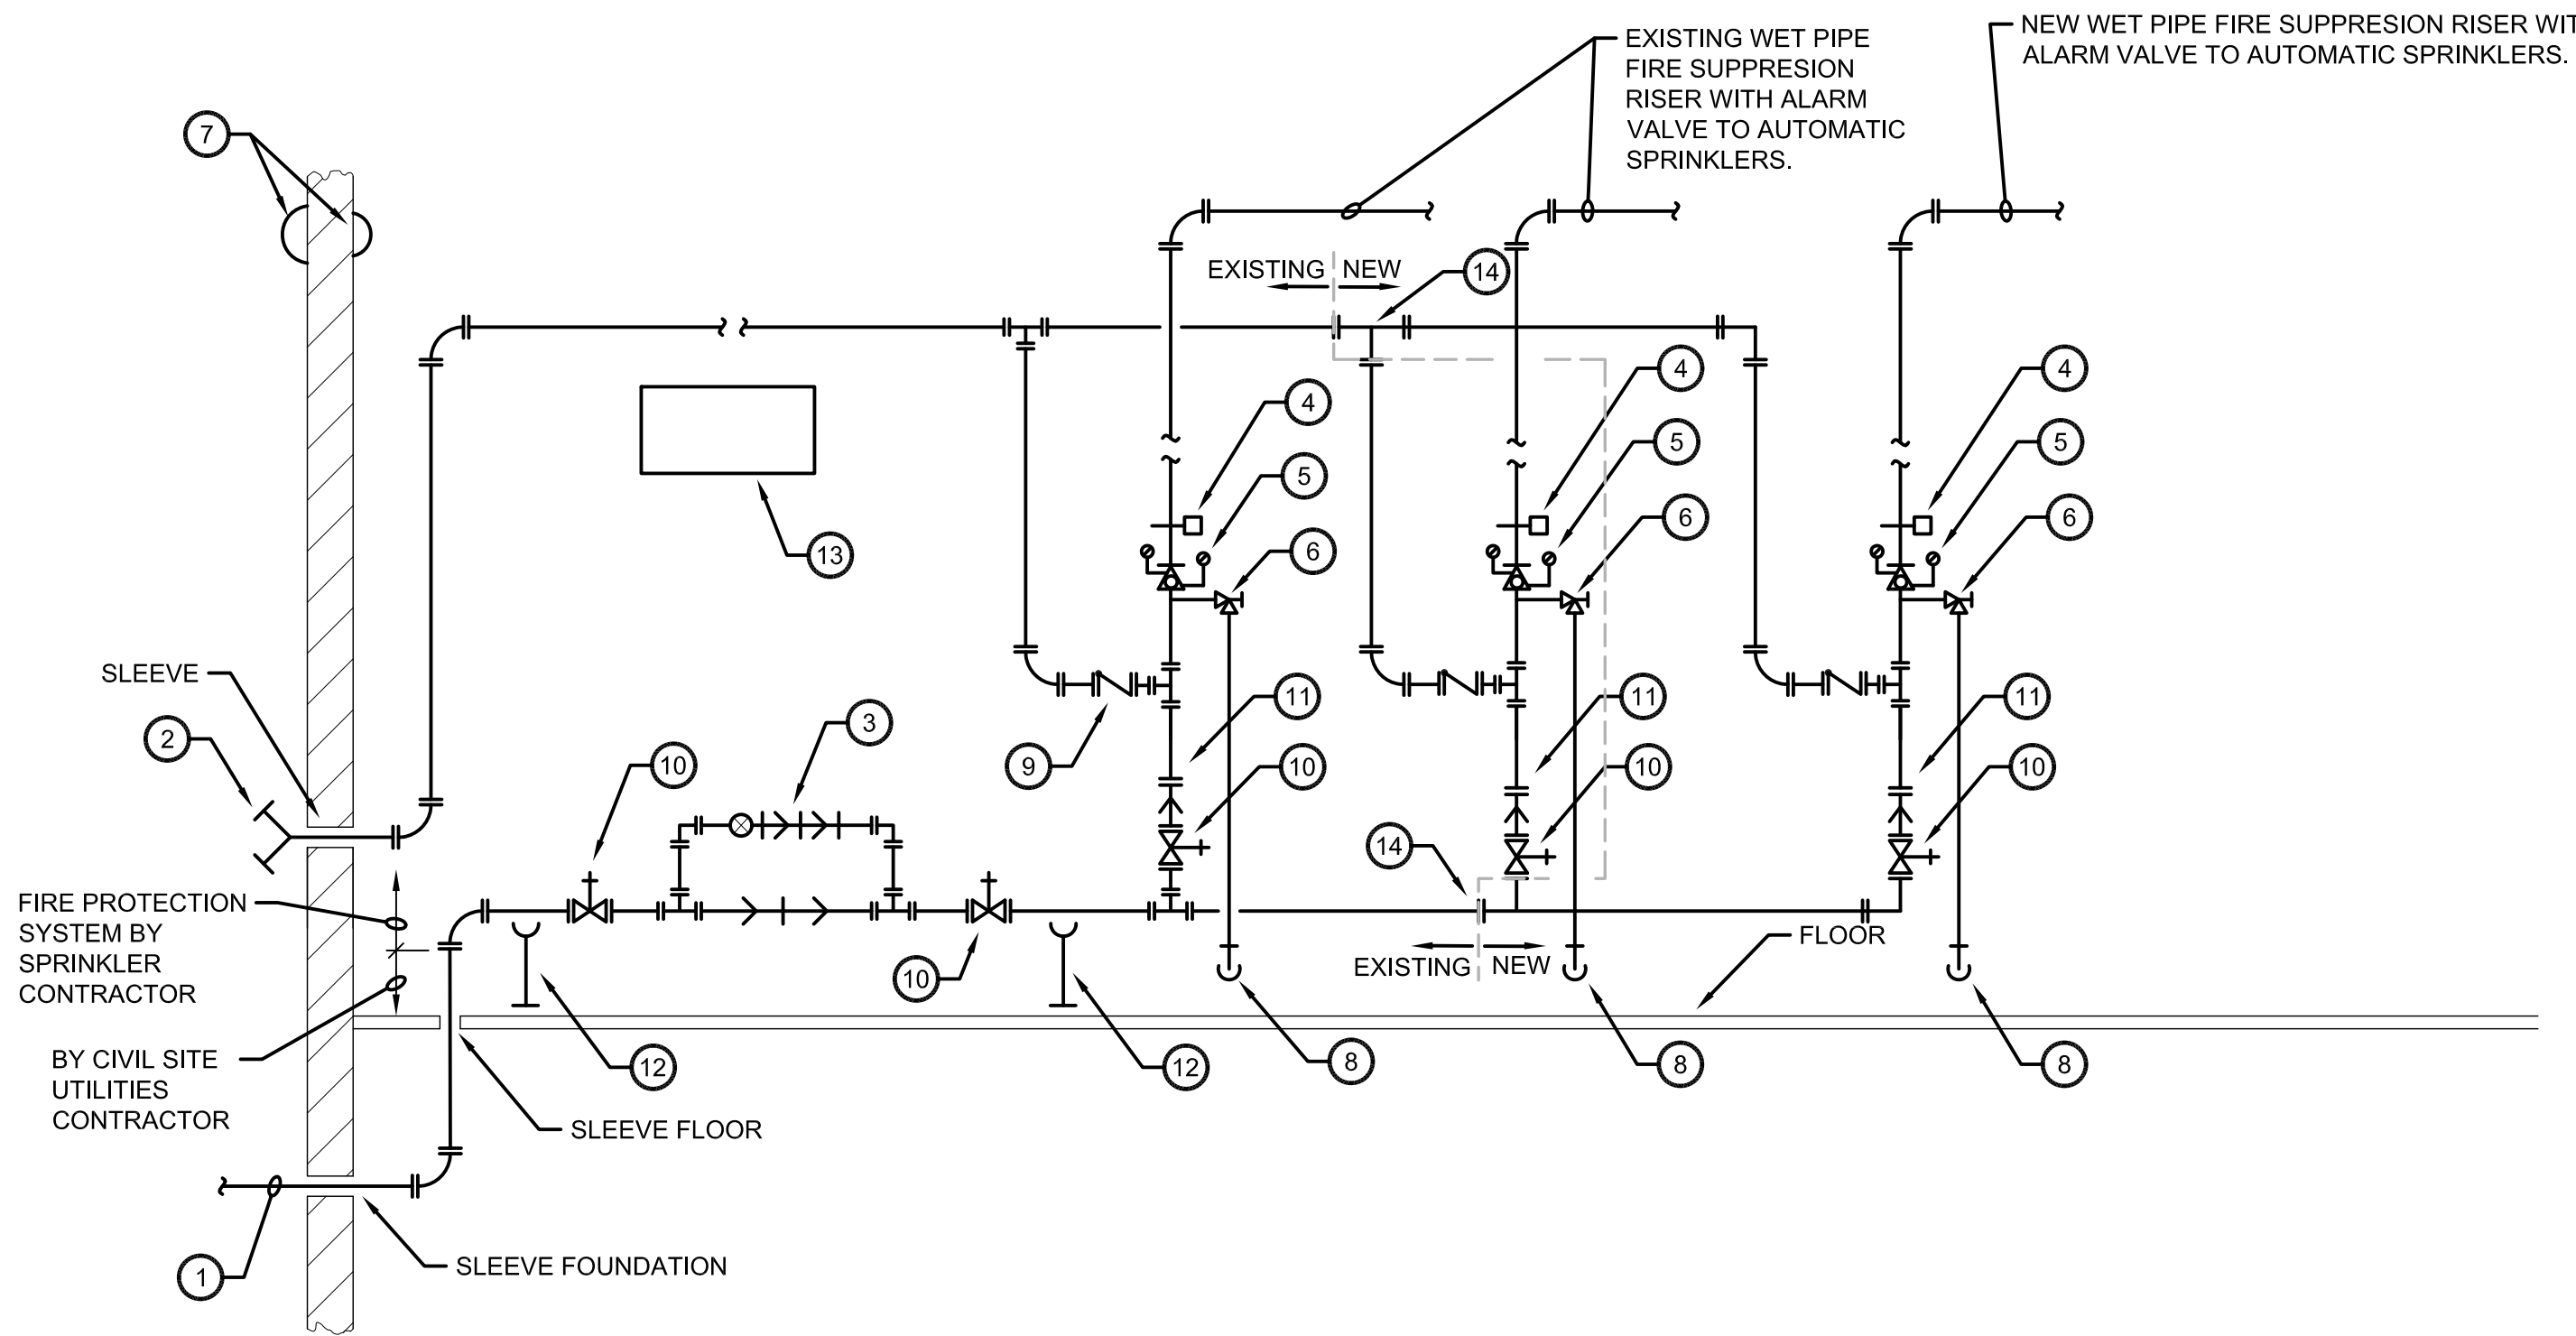

8 FIRE PROTECTION WATER SERVICE PIPING AND AUTOMATIC SPRINKLER ZONE RISER SCHEMATIC DETAIL
NOT TO SCALE

LANDLORD WORK FOR FUTURE ULTA #1619
2870S. 6TH ST.
KLAMATH FALLS, OR 97603

PLUMBING DETAILS

DICKERHOOF CONSTRUCTION
P.O. BOX 1800
CORVALLIS, OR 97339

WGW
Engineers, Inc.
Wesley G. Williams, P.E.
Tel. 650.555.9898
www.wgwengineers.com

- Revisions
- △ ISSUE FOR TENANT REVIEW 08/15/19
 - △ ISSUE FOR PERMIT 08/15/19
 - △
 - △
 - △
 - △



Signature: _____ Date: 08/15/2019
Expiration Date: 06/30/2020
I HEREBY CERTIFY THAT THESE PLANS HAVE BEEN PREPARED UNDER MY SUPERVISION AND THAT TO THE BEST OF MY KNOWLEDGE, THEY COMPLY WITH ALL RULES, REGULATIONS AND ORDINANCES OF KLAMATH FALLS, OR RELATING TO STRUCTURES AND BUILDINGS.
ENGINEER: _____
Drawn By: AK Checked By: DH
Scale: NO SCALE Date: 08/15/19
Job No.: _____

Sheet No. **P-3**

HN19230Dmgn19230_P4.dwg, P-6, 8/15/2019 10:09:56 AM, 1:1

SECTION 15500 BASIC MATERIALS AND METHODS			
PART 1 - GENERAL			
1.01 DESCRIPTION			
A. THIS SECTION DEFINES THE GENERAL PROVISIONS WHICH ARE COMMON TO ALL SECTIONS OF DIVISION 15.			
B. FURNISH ALL LABOR, MATERIALS, TOOLS AND EQUIPMENT; FABRICATE, AND INSTALL COMPLETE AND IN PLACE, ALL THE FIXTURES, EQUIPMENT AND SYSTEMS AS SHOWN ON THE DRAWINGS, SPECIFIED HEREIN, AND AS REQUIRED FOR A COMPLETE AND OPERABLE INSTALLATION.			
C. THE CONTRACTOR SHALL PAY FOR ALL PERMITS, FEES AND CHARGES REQUIRED FOR THIS WORK.			
1.02 DRAWINGS AND SPECIFICATIONS			
A. DESIGN DRAWINGS: THE DRAWINGS ACCOMPANYING THESE SPECIFICATIONS ARE GENERALLY DIAGRAMMATIC. ANY CHANGES FROM THE GENERAL ROUTING SHOWN ON THE DRAWINGS SUCH AS OFFSETS, BENDS OR CHANGES IN ELEVATION DUE TO COORDINATION WITH THE WORK OF OTHER TRADES AND THE BUILDING CONSTRUCTION SHALL BE DONE WITHOUT ADDITIONAL CHARGE TO THE OWNER.			
B. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE SUBMITTED FOR EACH AND EVERY ITEM OF MANUFACTURED MATERIAL AND EQUIPMENT.			
C. RECORD DRAWINGS			
1. THE CONTRACTOR SHALL KEEP AN ACCURATE RECORD OF ALL CONCEALED PIPES, DUCTS, VALVES, CONDUITS, ETC. IN ADDITION, HE SHALL RECORD, IN A SPECIAL SET OF CONTRACT DRAWINGS, ALL CHANGES AND DEVIATIONS FROM THE DESIGN DRAWINGS THAT OCCURRED DURING THE INSTALLATION OF THE WORK.			
2. AT COMPLETION OF THE JOB, THESE DRAWINGS ILLUSTRATING CHANGES OR DEVIATIONS SHOWING BY DIMENSION AND LOCATION THE EXACT POSITION OF ALL CONCEALED PIPES, VALVES, ETC., SHALL BE DELIVERED TO THE ARCHITECT/ENGINEER.			
D. SPECIFICATIONS - REFER TO THE FOLLOWING GENERAL SPECIFICATIONS AS THEY ARE A PART OF ALL SECTIONS OF DIVISION 15.			
1. DIVISION 1 - GENERAL REQUIREMENTS, REGARDING BUT NOT LIMITED TO: ALTERATION PROJECT PROCEDURES, SUBMITTALS, CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS, CLEANING DURING CONSTRUCTION, AND PRODUCT OPTIONS AND SUBSTITUTIONS.			
2. DIVISION 2 - SITEWORK, REGARDING BUT NOT LIMITED TO: SELECTIVE DEMOLITION, EARTHWORK, EXCAVATION AND BACKFILLING.			
3. DIVISION 3 - CONCRETE, REGARDING BUT NOT LIMITED TO: CAST-IN-PLACE CONCRETE, FORMWORK AND REINFORCEMENT.			
E. IT IS THE INTENTION OF THIS SPECIFICATION SECTION THAT ALL ITEMS OF MATERIAL AND EQUIPMENT HEREIN SPECIFIED OR SHOWN ON THE DRAWINGS FOR EACH SECTION SHALL BE FURNISHED BY THE CONTRACTOR FOR THAT SECTION, AND INSTALLED BY THAT CONTRACTOR, UNLESS IT IS SPECIFICALLY STATED IN THE SECTION SPECIFICATION, OR SHOWN ON THE DRAWINGS, THAT ANY ITEM OF MATERIAL OR EQUIPMENT IS TO BE FURNISHED BY THE CONTRACTOR OF A SECTION AND INSTALLED BY THE CONTRACTORS OF OTHER SECTIONS, OR FURNISHED BY OTHER SECTION CONTRACTORS AND INSTALLED BY THE CONTRACTOR OF THE SECTION.			
1.03 CHASES AND RECESSES			
A. ALL CHASES, RECESSES AND MAJOR MASONRY OPENINGS AS SHOWN ON THE DRAWINGS WILL BE PROVIDED BY THE ARCHITECTURAL TRADES.			
1.04 LUBRICATION			
A. PRIOR TO TESTING, ALL EQUIPMENT SHALL BE PROPERLY LUBRICATED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. ONE SET OF TOOLS NECESSARY FOR LUBRICATION SHALL BE DELIVERED TO OWNER, AFTER PROPER LUBRICATING, ALL UNITS SHALL BE STARTED AND SUCCESSFULLY OPERATED BY THE CONTRACTOR IN THE PRESENCE OF THE ARCHITECT AND ENGINEER.			
B. EXCEPT FOR SMALL ELECTRICAL MOTORS WHICH UNDER NEMA STANDARDS ARE EQUIPPED WITH LIFETIME LUBRICATION, ALL BEARINGS ON LARGE MOTORS AND MECHANICAL EQUIPMENT SHALL BE EQUIPPED WITH LUBRICATOR FITTINGS EXTENDED TO THE EXTERIOR OF THE HOUSING.			
1.05 POWER WIRING			
A. MOTORS UP TO AND INCLUDING 1/3 H.P. SHALL BE 120 VOLT, 60 HERTZ, SINGLE PHASE AND MOTORS 1/2 H.P. AND LARGER SHALL BE 240 VOLT, 60 HERTZ, THREE PHASE, UNLESS OTHERWISE INDICATED PER DRAWING SCHEDULES, PLANS AND DETAILS.			
B. THE CONTRACTOR SHALL PROVIDE COMBINATION MAGNETIC STARTERS WITH H.O.A. SWITCH FOR EACH ITEM OF THREE PHASE EQUIPMENT AND UNFUSED DISCONNECTS FOR EACH ITEM OF SINGLE PHASE EQUIPMENT, EXCEPT WHERE STARTERS ARE FURNISHED AS A PART OF WIRED EQUIPMENT.			
C. THE ELECTRICAL CONTRACTOR SHALL DO ALL POWER WIRING INCLUDING CONNECTIONS TO THE MOTORS FURNISHED BY THE CONTRACTOR.			
D. REFER TO SECTION 15900 FOR THE WIRING TO BE PERFORMED BY THE TEMPERATURE CONTROL CONTRACTOR AND THE ELECTRICAL CONTRACTOR AS THEY RELATE TO TEMPERATURE CONTROLS.			
1.06 FLUSHING AND TESTING			
A. ALL NEW WATER PIPING SYSTEMS SHALL BE FLUSHED USING WATER, LOW POINT DRAINS SHALL BE OPENED AND THE SYSTEMS PROVED TO BE DRAINABLE.			
B. ALL CLOSED SYSTEMS, OPERATING UNDER PRESSURE, SHALL BE TESTED, WITH WATER, AT 1 1/2 TIMES THEIR OPERATING PRESSURE.			
C. ALL OPEN SYSTEMS, SEWERS, ETC., SHALL BE TESTED WITH WATER, AT A HEAD OF FIVE (5) FEET ABOVE FINISHED FLOOR OR GRADE.			
D. GAS PIPING SHALL BE FLUSHED USING 100 PSIG COMPRESSED AIR, AFTER CLEANING PIPING SHALL FIRST BE AIR TESTED, AND THEN GAS TESTED, WITH A PRESSURE OF NO MORE THAN 1 W.G. AND FINAL, TESTED WITH A MERCURY MANOMETER AT 6" W.G. THE FIRST TEST SHALL BE APPLIED FOR A MINIMUM OF ONE (1) HOUR, THE SECOND TEST FOR PERIOD OF 15 MINUTES.			
E. ALL PIPING SYSTEMS SHALL BE TESTED, IF LEAKS OCCUR, THE PIPE OR FITTING SHALL BE REMOVED AND REPLACED AND THE SYSTEM RETESTED.			
F. PIPING SHALL NOT BE BACKFILLED OR INSULATED UNTIL TESTED. TESTS MUST BE OBSERVED BY THE ARCHITECT/ENGINEER.			
1.07 SUPPORTS			
A. CONTRACTOR SHALL FURNISH AND INSTALL ALL ANGLES, CHANNELS, PLATES, OR BEAMS REQUIRED FOR THE SUPPORT OF THE EQUIPMENT OF EACH SECTION, WHETHER SHOWN ON THE DRAWINGS OR NOT.			
B. FURNISH AND INSTALL ALL RODS, AUXILIARY STRUCTURAL STEEL FRAMES, ATTACHMENTS, BRACKETS AND PLATFORMS REQUIRED FOR SUPPORT OF EQUIPMENT FROM OVERHEAD CONSTRUCTION FOR THE RESPECTIVE SECTION.			
C. VERTICAL PIPE RISERS SHOWN AT THEIR HEIGHT, AND SHALL BE SUPPORTED AT EACH FLOOR BY 1-1/2" X 1/4" BAR CLAMPS ATTACHED TO PIPES AND RESTING ON THE FLOOR CONSTRUCTION.			
D. HORIZONTAL PIPING SHALL BE SUPPORTED BY ADJUSTABLE, WROUGHT, CLEVELT TYPE HANGERS, FEE & MASON, ELCON, OR CRAWFORD, WHERE PARALLEL PIPES ARE INSTALLED AT THE SAME LEVEL, PROVIDE TRAPPEZ HANGERS, THE VARIOUS TRADES SHALL COOPERATE IN THE JOINT USE OF SUCH HANGERS. PIPE HANGERS SHALL BE OF SIZE TO SUIT PIPE COVERING PROTECTION SADDLES.			
E. PIPES SHALL BE SUPPORTED ONLY FROM THE STRUCTURAL MEMBERS OF THE BUILDING. THEY SHALL BE SUPPORTED AT SUCH INTERVALS AS WILL PREVENT SAGGING, AND SO THAT EXCESSIVE LOADS WILL NOT BE PLACED UPON ANY ONE SUPPORT. SPACING AND ROD SIZES SHALL BE AS FOLLOWS:			
F. HANGER RODS SHALL BE FULL-DIAMETER STEEL, WITH THREADED ENDS FOR FIELD CUTTING AND THREAD EXTENDING AS REQUIRED, WHERE THREADED ROD IS SHORTER THAN 6" IT SHALL BE DRIPPED IN RESIST PAST PRIOR TO INSTALLATION.			
G. AT THE CONTRACTORS OPTION, HANGER RODS SHALL BE CONTINUOUS THREADED STEEL WITH GALVANIZED FINISH.			
H. HANGER RODS SHALL NOT BE BENT OR ALTERED IN ANY MATTER AND SHALL BE INSTALLED PLUMB AND TRUE. THE ROD SUPPORTING THE HANGER SHALL BE NO LONGER THAN 12" BELOW THE LOWER NUT.			
I. ALTERNATE WIRE ROPE HANGER SYSTEM (CONTRACTOR OPTION)			
A. GENERAL: AT THE OPTION OF THE CONTRACTOR AND IF APPROVED BY AUTHORITIES HAVING JURISDICTION, WIRE ROPE SYSTEM MAY BE USED IN LIEU OF CONVENTIONAL HANGERS. MINIMUM LOAD SAFETY FACTOR OF 5:1.			
B. WIRE ROPE HANGER SYSTEM AND LOCKING DEVICES TO BE ONE OF THE FOLLOWING MANUFACTURED SYSTEMS:			
1. DUCTIMATE INDUSTRIES, CHARLEROI, PA. - CLUTCHER MECHANICAL HANGER SYSTEM WITH ZINC COATED STEEL AIRCRAFT QUALITY ROPE (FIELD CUT TO LENGTH), LOCKING DEVICE TO BE CLUTCHER CAST ZINC HANGING WITH STAINLESS STEEL SPRINGS.			
2. GRIFFLE, INC., BATAVIA, IL. - HANK FAST WIRE ROPE HANGING SYSTEM WITH ZINC GALVANIZED STEEL WIRE ROPE, STANDARD LENGTHS OF 5, 10, 15 AND 30 FT WITH A PERFORATED LOOP AT ONE END, LOCKING DEVICE TO BE GRIPPLE ZINC HANGING WITH STAINLESS STEEL SPRINGS.			
3. ERICO, INC., SOLON, OH. - GADY SPEED LINK UNIVERSAL SUPPORT SYSTEM WITH GALVANIZED STEEL AIRCRAFT QUALITY WIRE ROPE, AVAILABLE IN 3.3, 6.6, 9.9, 16.4, AND 32.8 FT. LENGTHS WITH FACTORY HOOK AT ONE END, LOCKING DEVICE TO BE ERICO STAINLESS STEEL HANGING WITH ALL STEEL LOCKING DEVICE.			
1.08 VALVES			
A. ALL CONNECTIONS SHALL BE PROPERLY VALVED: INSTALL VALVES IN THE DOMESTIC COLD WATER SUPPLY, HOT WATER SUPPLY, HOT WATER RETURN, AND NATURAL GAS SUPPLY AND ALL OTHER LOCATIONS AS MAY BE NECESSARY TO SHUT OFF A PORTION OF A SYSTEM WHETHER SHOWN ON THE DRAWINGS OR NOT, AND SPECIFICALLY WHERE HEREINAFTER SPECIFIED.			
B. ALL VALVES SHALL COMPLY WITH THE SCHEDULE OR LEGEND ON THE DRAWINGS.			
C. WHERE VALVES ARE NOT SCHEDULED OR SHOWN IN THE LEGEND, THEY SHALL BE RATED FOR THE SERVICE.			
D. ANY DOMESTIC HOT WATER SUPPLY OR COLD WATER SUPPLY SERVING TWO OR MORE FIXTURES SHALL BE SEPARATELY VALVED IN ADDITION TO THE SHUT OFF VALVE REQUIRED AT EACH FIXTURE.			
E. MAKE PROVISIONS FOR DRAINING ALL LOW POINTS OF ALL PIPING SYSTEMS WHETHER INDICATED ON THE DRAWINGS OR NOT, USING A GLOBE VALVE OR A TIGHT OTHER PIPE THREAD TO HOSE THREAD ADAPTER WITH CAP. DRANS SHALL NOT BE LESS THAN 3/4".			
1.09 VALVE TAGS			
A. EACH VALVE ON EVERY PIPELINE SHALL BE PROVIDED WITH A NUMBERED BRASS TAG WHICH SHALL BE FASTENED TO THE PIPE OR LINE WITH NON-RUSTING WIRE. WHEN ALL WORK IS COMPLETE, DELIVER TO THE ARCHITECT/ENGINEER A FRAMED UNDER GLASS CHART WHICH SHALL INDICATE THE SERVICE AND LOCATION OF EACH VALVE. VALVES USED FOR LOCAL SHUT-OFF MAY BE OMITTED FROM THIS LIST.			
1.10 EQUIPMENT IDENTIFICATION			
A. ALL MECHANICAL EQUIPMENT SHALL BE CLEARLY IDENTIFIED WITH 2" HIGH STENCILED LETTERS, PAINTED ON THE EQUIPMENT (I.E. "WH-1"), THIS INCLUDES EXTERIOR EQUIPMENT WHERE THE PAINT SHALL BE WEATHER RESISTANT.			

PART 2 - PRODUCTS			
2.01 DESCRIPTION			
A. THIS PART DEFINES THE PIPE AND FITTINGS TO BE USED FOR ALL SERVICES INSTALLED UNDER DIVISION 15.			
B. REFER TO THE DRAWING LEGENDS AND SYMBOL SCHEDULES FOR DEFINITION OF THE DESIGNATORS USED IN THE FOLLOWING SPECIFICATION.			
2.02 PIPE AND FITTINGS RELATED TO SECTION 15400			
1. PIPING DESIGNATORS: CWS, HWS, HWR, AND TWS.			
A. PIPING SHALL BE TYPE 'K' HARD COPPER TUBING MADE UP WITH WROUGHT COPPER FITTINGS USING 95% LEAD FREE SOLDER.			
2. CWS AND HWS PIPING UNDER FLOOR SHALL BE TYPE 'K' HARD COPPER WITH FLARE FITTINGS.			
B. WITH MAIN, REFER TO DIVISION 3 SPECIFICATIONS SECTIONS AND/OR CIVIL ENGINEERING DRAWINGS AND COMPLY WITH AUTHORITIES HAVING JURISDICTION.			
C. SANITARY AND STORM ABOVE GRADE BUILDING			
1. PIPING SHALL BE SERVICE WEIGHT CAST IRON SOIL PIPE, ASTM A74, WITH LEAD AND OAKUM JOINTS.			
A. PREFORMED JOINTS MAY BE USED IF ACCEPTABLE TO THE LOCAL AUTHORITIES HAVING JURISDICTION.			
2. POLYVINYL CHLORIDE (PVC), SCHEDULE 40, PIPE AND FITTINGS, ASTM D2685, WITH PRIMER AND SOLVENT CEMENT JOINTS MAY BE USED IF ACCEPTABLE TO THE LOCAL AUTHORITIES HAVING JURISDICTION.			
D. SANITARY AND STORM ABOVE GRADE BUILDING			
1. 2-1/2" AND LARGER: PIPING SHALL BE SERVICE WEIGHT CAST IRON SOIL PIPE AND FITTINGS, ASTM A74, WITH LEAD AND OAKUM JOINTS.			
A. CAST IRON JOINTS SHALL BE USED IF ACCEPTABLE TO THE LOCAL AUTHORITIES HAVING JURISDICTION.			
2. 2" AND SMALLER: PIPING SHALL BE SCHEDULE 40 GALVANIZED PIPE, ASTM A133 OR ASTM 120, WITH BLACK CAST IRON DRAINAGE FITTINGS.			
A. CAST IRON JOINTS SHALL BE USED IF ACCEPTABLE TO THE LOCAL AUTHORITIES HAVING JURISDICTION.			
3. POLYVINYL CHLORIDE (PVC), SCHEDULE 40, PIPE AND FITTINGS, ASTM D2685, WITH PRIMER AND SOLVENT CEMENT JOINTS MAY BE USED IF ACCEPTABLE TO LOCAL AUTHORITIES HAVING JURISDICTION.			
A. NO CELLULAR CORE OR FOAMED PIPE WILL BE PERMITTED.			
2.03 PIPE AND FITTINGS RELATED TO SECTION 15350			
A. GAS PIPING			
1. GAS PIPING ABOVE THE FLOOR SHALL BE BLACK, SCHEDULE 40, ASTM A120 STEEL PIPE. FITTINGS SHALL BE GALVANIZED, MALLEABLE CAST IRON FOR PIPING 2" AND SMALLER AND WELDING FITTINGS FOR PIPING 2-1/2" AND LARGER.			
2. GAS PIPING BELOW GRADE SHALL BE BLACK, SCHEDULE 80, ASTM A120, ALL WELDED CONSTRUCTION, WRAPPED WITH ASPHALT IMPREGNATED KRAFT PAPER, FINISH JOINTS WITH BITUMASTIC 50 AND PAPER.			
2.04 ACCESS DOORS			
A. PROVIDE 24" X 24" ACCESS DOORS MANUFACTURED AS AN INTEGRAL UNIT COMPLETE WITH ALL PARTS AND READY FOR INSTALLATION AS MANUFACTURED BY ONE OF THE FOLLOWING:			
1. BIRMINGHAM ORNAMENTAL.			
2. KARP.			
3. MILDRED, DIVISION OF NRYCO.			
B. PROVIDE FLUSH PANEL DOORS, EXCEPT PROVIDE RECESSED PANEL DOORS WHERE ACCESS DOORS OCCUR IN PLASTER OR ACUSTICAL TILE GLEED TO GYPSUM LATH.			
C. PROVIDE 1/4" 18" LABELED UNITS WHERE ACCESS DOORS OCCUR IN HOUR RATED CONSTRUCTION.			
D. PROVIDE SCREW DRIVER OPERATED CASK LOCKS OF NUMBER REQUIRED BY SIZE OF DOOR.			
E. PROVIDE ANCHORAGE APPROPRIATE TO CONSTRUCTION.			
PART 3 - EXECUTION			
3.01 CUTTING AND PATCHING			
A. ALL CUTTING, PATCHING, FITTING AND REFINISHING OF IN PLACE CONSTRUCTION REQUIRED FOR THE INSTALLATION OF THE WORK OF A SECTION SHALL BE DONE AT THE EXPENSE OF THE CONTRACTOR OF THE SECTION, EXCEPT AS SPECIFICALLY SHOWN ON THE DRAWINGS OR HEREINAFTER SPECIFIED.			
B. WORK SHALL BE PERFORMED BY CRAFTSMEN SKILLED IN THEIR RESPECTIVE TRADES.			
3.02 EXCAVATING			
A. THE CONTRACTOR OF EACH SECTION SHALL DO ALL EXCAVATING AND BACKFILLING AS REQUIRED FOR THE INSTALLATION OF HIS WORK.			
B. THE WORK SHALL BE PERFORMED IN ACCORDANCE WITH DIVISION 2 SPECIFICATION SECTIONS AND AS HEREINAFTER SPECIFIED.			
C. EXCESS EARTH FROM THE EXCAVATIONS SHALL BE DEPOSITED ON THE SITE WHERE DIRECTED.			
D. ALL EXCAVATIONS SHALL BE BACKFILLED AS FOLLOWS:			
1. WITHIN THE BUILDING WALLS AND UNDER THE BUILDINGS: BANK RUN GRANULAR FILL COMPACTED TO 95% MODIFIED PROCTOR.			
2. UNDER CEMENTS AND PAVED AREAS, FILL WITHIN THE BUILDINGS.			
3. IN GRASSY AREAS, FILL WITH BANK RUN GRANULAR FILL TO A DEPTH OF 12 INCHES OVER THE HIGHEST PART OF THE PIPING AND FINISH WITH ACCEPTABLE EXCAVATED MATERIAL.			
3.03 OPERATING INSTRUCTIONS			
A. THE CONTRACTOR FOR THE SECTION SHALL, WHEN DIRECTED BY THE ARCHITECT/ENGINEER, PROVIDE THE OWNER WITH A COMPETENT TRADESMAN TO INSTRUCT THE OWNER'S PERSONNEL IN THE PROPER OPERATION AND MAINTENANCE OF THE EQUIPMENT HE HAS INSTALLED.			
B. PROVIDE COPIES OF OPERATING INSTRUCTIONS, EQUIPMENT MANUALS, AND CONTROL DIAGRAMS PERMITTED CLOSE TO THE EQUIPMENT.			
C. CONTROL DIAGRAMS AND WRITTEN INSTRUCTIONS SHALL BE FRAMED UNDER GLASS.			
3.04 CODES AND STANDARDS			
A. PIPING AND APPURTENANCES INSTALLED UNDER THIS DIVISION OF THE SPECIFICATIONS SHALL COMPLY WITH THE REQUIREMENTS OF THE FOLLOWING, WHERE APPLICABLE: ANSI CODES FOR PRESSURE PIPING.			
ANSI STANDARDS FOR PIPE AND FITTINGS			
B. FACTORY INSURANCE ASSOCIATION			
C. AMERICAN WATER WORKS ASSOCIATION			
D. IN ADDITION, THE WORK SHALL CONFORM TO ALL APPLICABLE STATE AND LOCAL CODES AND ORDINANCES.			
3.05 WORK CLEANLINESS			
A. CONTRACTOR SHALL KEEP STORED MATERIALS, STORAGE AREAS, AND INSTALLED EQUIPMENT FREE OF DIRT AND DEBRIS.			
B. ALL EXPOSED ENDS OF INCOMPLETE OR UNCOVERED WORK SHALL BE TEMPORARILY COVERED AS EACH PHASE OF PIPING WORK AND DUCTWORK IS COMPLETED.			
C. PIPING AND EQUIPMENT TO BE PAINTED (EXPOSED TO VIEW IN COMPLETED STRUCTURE) SHALL BE CLEANED BY REMOVING RUST, PLASTER, AND DIRT BY WIRE BRUSHING, GREASE, OIL, AND SIMILAR MATERIALS SHALL BE REMOVED BY WIPING WITH CLEAN RAGS AND SUITABLE SOLVENTS.			
D. MOTOR, PUMPS, AND OTHER ITEMS WITH FACTORY FINISH SHALL BE REMOVED OF GREASE AND OIL AND LEAVE WITH ALL SURFACES CLEANED AND POLISHED.			
3.06 ARRANGEMENT AND ALIGNMENT			
A. ALL PIPING SHALL BE ARRANGED AND ALIGNED IN ACCORDANCE WITH THE DRAWINGS. ELEVATIONS AS GIVEN MUST BE HELD. FLOOR ELEVATIONS WHERE GIVEN ARE TO HIGH POINTS OF FLOOR. DIMENSIONS MUST BE HELD AS CLOSELY AS POSSIBLE. ALL DIMENSIONS ARE TO BE FIELD CHECKED FOR ACCURACY BEFORE PIPE IS FABRICATED.			
B. INSTALL ALL PIPING STRAIGHT AND DIRECT AS POSSIBLE, GENERALLY FORMING RIGHT ANGLES WITH, OR RUNNING PARALLEL WITH, WALLS OR ADJACENT PIPING. ALL PIPING SHALL BE NEATLY SPACED WITH RISERS AND DROPS RUNNING PLUMB AND TRUE.			
C. RUN PIPING IN WALL CHASES, PIPE SHEDS, HUNGERS, RECESSES, ETC., WHERE SAME ARE PROVIDED. DO NOT RUN SERVICE PIPING IN FLOOR SLAB FILL UNLESS SPECIFICALLY SO NOTED ON DRAWINGS. PIPING SHALL NOT BE COVERED OR CHECKED UNTIL TESTING IS COMPLETED.			
D. DRAWINGS, IN GENERAL, ARE MADE TO SCALE. ALL DIMENSIONS SHALL BE CHECKED BY THE FIELD BEFORE THE PIPING IS INSTALLED. THE ACTUAL ARRANGEMENT OF THE PIPING, WHEN ERECTED, SHALL FOLLOW THE GENERAL LOCATIONS SHOWN ON THE DRAWINGS AS FAR AS PRACTICABLE. THE INSTALLATION MADE IN THIS WAY SHALL BE NEAT IN APPEARANCE AND CONVENIENT TO OPERATE, AND SHALL PROVIDE FOR PROPER EXPANSION AND DRAINAGE.			
F. INSTALLATION OF PIPING SYSTEMS SHALL BE COORDINATED WITH OTHER WORK TO AVOID BLOCKING BUILDING OPENINGS, WALLS, ETC. PIPING SHALL NOT INTERFERE WITH ACCESS TO VALVES OR EQUIPMENT AND SHALL NOT OBSTRUCT PASSAGEWAYS. PIPING SHALL BE INSTALLED TO PROVIDE WORKING CLEARANCE FOR OPERATION AND MAINTENANCE.			
3.07 MODIFICATIONS AND INTERFERENCES			
A. CONTRACTOR SHALL CAREFULLY CHECK AND BECOME FAMILIAR WITH THE ARCHITECTURAL, STRUCTURAL, ELECTRICAL AND ALL MECHANICAL DRAWINGS AND DETAILS, AND MAKE NOTE OF ALL LOCATIONS WHERE WALLS, PARTITIONS, CEILINGS, STRUCTURAL MEMBERS, ETC., ARE CALLED FOR TO BE FURRED OR CLOSED-IN.			
B. MODIFICATIONS TO THE ARRANGEMENT OF THE PIPING SYSTEM MAY BE REQUIRED TO SORT WATER, WITH GLAND AND GASKET IN PLACE ON SPOOT, INSERT INTO BELL, SEAT SPOOT AND BELL AND PRESS GASKET INTO BELL AND PLUG GLAND AGAINST BELL. INSTALL ANCHORS WHERE SHOWN ON THE DRAWINGS OR ON THE DRAWINGS.			
C. IF A QUESTIONABLE INTERFERENCE IS NOTED ON THE DRAWINGS, THE CONTRACTOR SHALL BE CALLED TO THE ATTENTION OF THE ARCHITECT AND/OR ENGINEER FOR CLARIFICATION BEFORE PROCEEDING WITH FABRICATION OR ERECTION OF THE PARTS AFFECTED. IF, IN THE OPINION, ANY ADDITIONAL DETAIL DRAWINGS ARE NECESSARY, HE SHALL PREPARE THEM AT HIS OWN EXPENSE, TOGETHER WITH ALL BILLS OF MATERIAL.			
3.08 PIPE CLEARANCES			
A. INSTALL PIPING TO PROVIDE MINIMUM CLEARANCE OF AT LEAST ONE INCH BETWEEN EXTREME PROJECTIONS OF PIPING, FLANGES, FITTINGS, VALVES, ALLOWING FOR INSULATION, PIPE EXPANSION AND THE LIKE.			
3.09 PIPING EXPANSION			
A. SPECIAL ATTENTION SHALL BE GIVEN TO THE INSTALLATION OF HOT AND COLD LINES WHICH HAVE AN APPRECIABLE MOVEMENT SO THAT THEY WILL NOT HIT OTHER PIPES, STRUCTURAL MEMBERS AND THE LIKE WHEN THEY HEAT UP OR COOL.			
B. INSTALL ANCHORS WHERE SHOWN ON THE DRAWINGS AND WHERE REQUIRED.			
C. GUIDES ARE TO BE FURNISHED ON EACH SIDE OF ALL EXPANSION LOOPS, OFFSETS, SWINGS JOINTS AND EXPANSION JOINTS WHETHER OR NOT DETAILED ON THE DRAWINGS.			
D. COLD SPRINGING WHERE REQUIRED SHALL BE DONE WITH ANCHORS, HANGERS AND SLIDING SUPPORTS IN PLACE.			
3.10 LOCATION OF VALVES, ETC.			
A. SYSTEM COMPONENTS WHICH REQUIRE OBSERVATION, OPERATION OR MAINTENANCE, SUCH AS VALVES, GAUGES, CONTROLS, STRAINERS, DIRT POCKETS, CLEANOUTS, UNIONS AND FLANGES, ETC., SHALL BE LOCATED WHENEVER POSSIBLE SO AS TO BE READILY ACCESSIBLE. THEY SHALL NOT BE CONCEALED IN CHASES OR ABOVE CEILINGS WITHOUT PROVISION FOR ACCESS. VALVES WHICH REQUIRE FREQUENT OPERATION, OR WHICH MAY REQUIRE EMERGENCY OPERATION, AND WHICH ARE NOT ACCESSIBLE FROM NORMAL WORKING LEVEL, SHOULD BE INSTALLED WITH APPROPRIATE PROVISIONS SUCH AS CHAIN WHEELS OR EXTENSION STEMS.			
B. INSTALL ALL VALVES WITH STEMS IN EITHER AN UPRIGHT (PREFERRED) OR HORIZONTAL POSITION. CONTROL VALVES SHALL BE INSTALLED WITH TOP WORKS UPWARD UNLESS SPECIFICALLY SHOWN OTHERWISE.			
C. GLOBE VALVES MUST BE INSTALLED TO SEAT AGAINST THE DIRECTION OF FLOW.			

3.1.1 DRAINAGE AND VENTING

A. WHERE LINES ARE PURPOSELY PITCHED FOR DRAINAGE OR VENTING, AN ACCURATE GRADE SHALL BE MAINTAINED. LINES SHALL BE SUPPORTED IN SUCH A MANNER AS TO PREVENT DEFLECTION OF THE PIPING SUFFICIENT TO POCKET THE LINES.

3.1.2 PIPE AND FITTINGS

A. ALL PIPE SIZES REFERRED TO IN THESE SECTIONS SHOULD BE INTERPRETED AS IPS (IRON PIPE SIZE) UNLESS SPECIFICALLY DESIGNATED OTHERWISE, SUCH AS "OD" FOR TUBING.

B. ALL LENGTHS OF PIPE SHALL BE USED WHEREVER POSSIBLE. SHORT LENGTHS OF PIPE WITH COUPLINGS WILL NOT BE PERMITTED.

C. ALL PIPE SHALL BE CUT TO EXACT MEASUREMENT TO BE INSTALLED WITHOUT FORCING (EXCEPT WHERE SPECIAL SPECIFICATIONS ARE SPECIFICALLY CALLED FOR). AFTER CUTTING, ENDS SHALL BE REAMED AND CLEANED TO ELIMINATE FOREIGN MATTER.

D. CUTTING OR OTHER WEAKENING OF THE BUILDING STRUCTURE TO FACILITATE PIPING INSTALLATION WILL NOT BE PERMITTED.

E. ALL PIPE AND FITTINGS SHALL BE MARKED BY THE MANUFACTURER IN ACCORDANCE WITH THE MARKING SECTIONS OF THE STANDARDS TO WHICH REFERENCE IS MADE IN THIS SPECIFICATION MANUAL. STANDARD MARKING SYSTEM FOR VALVES, FITTINGS, FLANGES AND UNIONS OF THE MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY.

F. MAKE ALL CHANGES IN SIZE AND DIRECTION OF PIPING WITH FITTINGS. DO NOT USE BENDS, MITER FITTINGS, FACE OR FLUSH BUSHINGS, STREET ELBOWS OR FIELD-FABRICATED REDUCERS.

G. CLOSE NIPPLES SHALL NOT BE PERMITTED: USE ONLY SHOULDER NIPPLES. SHOULDER NIPPLE WITH SHOULDER LENGTH LESS THAN 1-1/2" SHALL BE OF HEAVY WALL PIPE. NIPPLES HAVING SHOULDER LENGTH OF 1-1/2" OR GREATER SHALL BE OF SAME SCHEDULE AS CONNECTED PIPE.

H. UNLESS OTHERWISE SHOWN ON THE DRAWINGS, INSTALL ALL SUPPLY PIPING TO COILS, PUMPS AND OTHER EQUIPMENT INCLUDING VALVES AND STRAINERS THEREIN, AT LINE SIZE. THE MINIMUM LINE IS REQUIRED AT A PUMP CONNECTION. THE REDUCER SHALL BE INSTALLED ABOUTING THE INLET AND/OR OUTLET OF THE PUMP OR VALVE.

3.1.3 WELDING FITTINGS

A. BUTT-WELDING FITTINGS SHALL BE MANUFACTURED ACCORDING TO ANSI STANDARD B31.3 (LATEST EDITION), MITERED JOINT ELBOWS AND FIELD FABRICATED REDUCERS ARE NOT PERMITTED.

B. MAKE ALL BRANCH CONNECTIONS WITH TEES, EXCEPT THAT ON STEEL PIPING, FORGED OR CASTED REDUCERS AS MANUFACTURED BY THE MANUFACTURER MAY BE USED IF THE BRANCH PIPE IS NOT LARGER THAN ONE-HALF THE SIZE OF THE MAIN PIPE (NOMINAL SIZES).

3.1.4 REDUCING FITTINGS

A. USE ECCENTRIC REDUCING FITTINGS OR ECCENTRIC REDUCING COUPLINGS WHERE REQUIRED TO PREVENT POCKETING OF LIQUID.

B. WHERE ECCENTRIC REDUCERS ARE USED, THE STRAIGHT SIDE SHOULD BE INSTALLED ON TOP FOR PUMP SUCTION AND BOTTOM FOR ALL OTHER LINES.

3.1.5 CONNECTIONS TO EQUIPMENT AND SPECIALTIES

A. PIPING SYSTEMS SHALL BE INSTALLED COMPLETE TO EQUIPMENT CONNECTIONS OR TERMINAL USE POINTS.

B. PIPING SHALL BE FABRICATED CAREFULLY AND ACCURATELY TO MEET CONNECTIONS ON EQUIPMENT WITHOUT SPRINGING THE PIPE.

C. PROVIDE UNIONS OR FLANGES AT ALL PIPING CONNECTIONS TO COILS, EQUIPMENT, CONTROL VALVES, PRESSURE OR TEMPERATURE VALVES, STEAM TRAPS, ETC. AT ALL LOCATIONS AS SHOWN ON THE DRAWINGS, AND GENERALLY AS REQUIRED TO DISCONNECT PIPING FROM EQUIPMENT AND APPARATUS. DISCONNECTS SHALL BE USED TO DISCONNECT EQUIPMENT SERVED MAY BE REMOVED WITHOUT DISTURBING THE PIPING. WHERE VALVES SERVE TO ISOLATE EQUIPMENT OR SPECIALTIES, THE UNIONS OR FLANGES SHALL BE LOCATED BETWEEN VALVES AND EQUIPMENT OR SPECIALTIES. DISCONNECTS SHALL BE USED FOR PIPE SIZES 2" AND SMALLER AND FLANGES FOR PIPE SIZES 2-1/2" AND LARGER.

3.1.6 DIELECTRIC CONNECTIONS

A. PROVIDE DIELECTRIC FITTINGS BETWEEN FERROUS AND COPPER PIPING.

3.1.7 PIPE SLEEVES

A. PROVIDE ALL PIPE OPENINGS THROUGH WALLS, PARTITIONS AND SLABS WITH SLEEVES BUILT UP ON INTERNAL DIAMETER AT LEAST 1" LARGER THAN THE OUTSIDE DIAMETER OF THE PIPE FOR UNINSULATED LINES OR OF THE THICKNESS OF THE INSULATION FOR INSULATED LINES.

B. INSTALL SLEEVES THROUGH INTERIOR WALLS AND PARTITIONS FLUSH WITH FINISHED SURFACES; SLEEVES THROUGH OUTSIDE WALLS ARE TO PROJECT 1/2" ON OUTSIDE OF THE EXTERIOR WALL. FLOOR SLEEVES ARE TO PROJECT 2" ABOVE FINISHED FLOORS.

C. SET SLEEVES IN PLACE BEFORE POURING CONCRETE OR SECURELY FASTEN AND GROUT IN WITH GEMENT.

D. SLEEVE CONSTRUCTION:
1. INTERIOR PARTITIONS: NO. 22 GAUGE GALVANIZED SHEET STEEL WITH SOLDERED JOINTS.
2. INTERIOR MASONRY WALLS AND FLOORS: SCHEDULE 40 GALVANIZED STEEL PIPE.
3. INTERIOR WALLS: FILL THE SPACE BETWEEN OUTSIDE OF PIPE OR INSULATION AND THE INSULATION WITH SLEEVE INSULATION AND GROUT OR FILL WITH CONCRETE.
4. EXTERIOR WALLS: PACK WITH OAKUM, SEAL WITH LEAD AND WATERTIGHT MASTIC OR GROUT.

E. PROVIDE ESCUTCHEONS ON BOTH SIDES OF THE PENETRATION THROUGH THE STRUCTURE FOR ALL PIPES EXPOSED TO VIEW PASSING THROUGH WALLS, FLOORS, CEILINGS, PARTITIONS, AND PARTITIONS. PROVIDE ESCUTCHEONS TO INCLUDE THE ANNUAL SPACE AROUND DUCTS, PIPING, CONDUITS, ETC. AND SHALL BE U.L. RATED MATERIALS AND METHODS PER THE ARCHITECTURAL SPECIFICATION SECTIONS. SUBMIT THROUGH PENETRATION PROTECTION SYSTEMS FROM ALL FIRE RATED ASSEMBLIES TO THE LOCAL AUTHORITIES AND THE ARCHITECT/ENGINEER FOR REVIEW.

3.1.8 SCREWED JOINTS

A. CUT THREADS FULL AND CLEAN WITH SHARP DIES.

B. REAM ENDS OF PIPE AFTER THREADING AND BEFORE ASSEMBLY, TO REMOVE BURRS.

C. LEAVE NOT MORE THAN THREE PIPE THREADS EXPOSED AT EACH CONNECTION.

D. USE JOINT SEALANT OR TAPE ON MATE THREADS ONLY.

3.1.9 FLANGED JOINTS

A. USE ALL FLANGED JOINTS WITH SQUARE HEADS AND HARD-PRESSED STEEL HEXAGON NUTS (THREADS TO THE ANSI STANDARD COARSE THREAD SERIES #21 FITS).

B. ALL BOLT HOLES ARE TO BE SPOT-FACED.

C. USE ALL FLANGES ON UNIONS AND DRAIN OR FILL TO CONFORM TO ANSI STANDARDS FOR THE PRESSURE CLASSES INVOLVED.

D. FLANGED JOINT IRON, FLANGE JOINTS SHALL BE FULL FLANGE JOINT, THE STEEL FLANGE, THE MATE MUST ALSO HAVE FULL, FLAT FACE. USE FULL FACE GASKET.

E. MATE RAISED-FACE FLANGES TO RAISED-FACE. USE RING TYPE GASKET.

3.2 SOLDERED AND BRAZED JOINTS

A. ALL SOLDERED AND/OR BRAZED JOINTS SHALL BE MADE IN ACCORDANCE WITH GOOD PRACTICE. THE TUBE ENDS SHALL BE SQUARE CUT AND REAMED, STRAIGHTENED AND ROUNDED WITH STRAIGHTENING TOOLS AS NECESSARY.

B. CLEAN AND TUBE SURFACES SHALL BE CLEANED WITH STEEL WOOL OR EMERY CLOTH AND A SUFFICIENT FLUX SHALL BE USED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. UNIFORM HEAT SHALL BE APPLIED BY THE USE OF TIME SAVING ELECTRIC TIG WELDER OR OXYACETYLENE TORCH. ADEQUATE COOLING TIME SHALL BE ALLOWED BEFORE WASHING OR QUENCHING. APPEARANCES THAT ARE FRAGILE OR EXTREMELY SENSITIVE TO MECHANICAL STRESS OR TO HEAT TREATING, OR THE SENSITIVE PARTS SHALL BE REMOVED DURING THIS APPLICATION OF HEAT.

C. ALL SOLDERED JOINTS SHALL BE MADE USING 95-5 SILVER SOLDER.

D. ALL BRAZED JOINTS SHALL BE MADE USING B30-30 OR SILVER SOLDER.

3.2.1 WELDED JOINTS

A. IN GENERAL, ALL WELDING ON CARBON STEEL PIPE AND FITTINGS SHALL BE DONE BY THE METAL ARC PROCESS.

B. REAM ENDS OF PIPE SHALL CONFORM TO CHAPTER V, OF THE CODE FOR PRESSURIZED PIPING, ANSI B31.3, LATEST EDITION.

C. WELDING OF ALL WELDED JOINTS SHALL BE CERTIFIED WHERE REQUIRED BY SECTION 10 OF THE ASME BOILER AND PRESSURE VESSEL CODE, LATEST EDITION.

D. TACK WELDS USED IN ASSEMBLY PIPE, FITTINGS, ETC., SHALL BE MADE BY A QUALIFIED WELDER OR TACK WELDS SHALL BE MADE BY A QUALIFIED WELDER. IF NOT REMOVED, SHALL BE MADE WITH AN ELECTRODE WHICH IS THE SAME AS OR EQUIVALENT TO THE ELECTRODE TO BE USED FOR THE FIRST PASS. TACK WELDS MUST BE THOROUGHLY CLEANED, GROUND, METAL MAY BE EXPOSED. NO METAL SHALL BE TACK-WELDED INSIDE PIPE FOR FLUID TIGHT PURPOSES.

3.2.2 CAULKED JOINTS

A. JOINTS IN CAST IRON BELL AND SPIGOT PIPING SHALL BE FIRMLY PACKED WITH OAKUM AND SHALL BE FILLED WITH PURE LEAD, MINIMUM 1" DEEP. JOINT SHALL THEN BE CAULKED.

3.2.3 PREFORMED JOINTS

A. WHERE ASTM C445 JOINTS ARE USED, THEY SHALL BE WIRED CLEAN AND THE SOLVENT APPLIED IN ACCORDANCE WITH ASTM PROCEDURES.

3.2.4 MECHANICAL JOINTS

A. CLEAN SPIGOT AND BELL WITH WIRE BRUSH. BRUSH SURFACES AND GASKET WITH BRUSH. BRUSH WITH GLAND RING. BR

<div>3.13 PIPING IDENTIFICATION A. ALL NEW PIPING INSTALLED UNDER THIS CONTRACT, SHALL BE IDENTIFIED AS TO THE TYPE OF SERVICE, AND THE DIRECTION OF FLOW, USING A SYSTEM CURRENTLY IN USE BY THE OWNER. B. WHERE PIPING IS INSULATED, PIPE IDENTIFICATION MARKERS SHALL BE INSTALLED AFTER THE INSULATION HAS BEEN INSTALLED. C. PIPE IDENTIFICATION MARKERS SHALL BE INSTALLED AT EACH EQUIPMENT CONNECTION AND ON TWENTY (20) FOOT CENTERS FOR RUNS OF STRAIGHT PIPING. 3.14 ACCESS DOORS A. INSTALL ACCESS DOORS IN THE BUILDING CONSTRUCTION WHERE SHOWN ON THE DRAWINGS OR WHERE REQUIRED TO ACCESS VALVES AND CLEANOUTS. B. COORDINATE INSTALLATION WITH THE GENERAL CONTRACTOR. 3.15 BACKFLOW PREVENTERS A. INSTALL PREVENTERS COMPLETE WITH DRAIN. ALL PIPING IN ACCORDANCE WITH MANUFACTURER'S LITERATURE. SECTION 15500 AUTOMATIC SPRINKLER SYSTEM PART 1 - GENERAL 1.01 GENERAL CONDITIONS AND SPECIAL CONDITIONS A. SECTION 15500, BASIC MATERIALS AND METHODS, APPLIES TO THE WORK SPECIFIED IN THIS SECTION. B. GENERAL AND SPECIAL CONDITIONS APPLY TO THE WORK UNDER THIS SECTION. C. A PRE-CONSTRUCTION MEETING BEFORE THE SHOP DRAWING PROCESS. A MEETING WILL BE HELD TO DISCUSS THE SENSITIVITY OF THE PIPING AND SPRINKLERS IN THE FACILITY AND ESPECIALLY THE SPECIAL CEILING. LOCATION OF AUTOMATIC SPRINKLES SHALL BE APPROVED THE ARCHITECT/OWNER. 1.02 SCOPE OF WORK A. AUTOMATIC WET PIPE SPRINKLER SYSTEM AND COMPONENTS AS SPECIFIED HEREIN AND AS MIGHT BE SHOWN ON DRAWINGS, INCLUDING PIPING, HANGERS, VALVES, ALARMS, SUPPORTS AND SPRINKLER HEADS, NECESSARY AND AS REQUIRED FOR INSTALLATION OF COMPLETE AND APPROVED FIRE PROTECTION SYSTEMS. B. WORK UNDER THIS SECTION SHALL BE PERFORMED BY AN APPROVED AND AUTOMATIC FIRE SPRINKLER CONTRACTOR. SHOP DRAWINGS AND CALCULATIONS SHALL BE PREPARED BY A REGISTERED PROFESSIONAL ENGINEER, APPROVED CONTRACTOR AND THE CONTRACTORS REGISTERED ENGINEER SHALL BE LICENSED WITH THE PROPER AUTHORITIES FOR THE LOCATION OF THIS PROJECT. C. WORK SHALL BE DONE IN A FIRST CLASS AND WORKMANLIKE MANNER, COMPLETE IN ALL RESPECTS INCLUDING ITEMS OF WORK SPECIFIED HEREIN OR OUTLINED AND ILLUSTRATED ON DRAWINGS AND NECESSARY TO ACCOMPLISH A COMPLETE, FULLY OPERATING, SATISFACTORY AND APPROVED INSTALLATION. 1.03 APPLICABLE STANDARDS A. LOCAL AND STATE FIRE MARSHAL CODES. B. NATIONAL FIRE PROTECTION ASSOCIATION STANDARDS. C. NFPA-13, SPRINKLER SYSTEMS. D. UNDERWRITERS LABORATORIES STANDARDS. E. OWNERS OR TENANTS INSURANCE UNDERWRITER. F. MATERIALS AND EQUIPMENT SHALL BE U.L. INC. APPROVED AND LISTED AND APPROVED BY FACTORY MUTUAL. 1.04 SHOP DRAWINGS A. UPON AWARD OF CONTRACT, FIRE PROTECTION CONTRACTOR SHALL IMMEDIATELY PREPARE WORKING DRAWINGS, HYDRAULIC CALCULATIONS, AND MANUFACTURERS DATA SHEETS FOR EACH AND EVERY ITEM OF EQUIPMENT AND MATERIAL; AND SUBMIT THE SAME FOR APPROVAL TO: 1. LOCAL FIRE PREVENTION BUREAU. 2. OWNERS OR TENANTS INSURANCE UNDERWRITER. 3. ARCHITECT/ENGINEER. B. AFTER APPROVAL, FIRE PROTECTION CONTRACTOR SHALL SUBMIT APPROVED WORKING DRAWINGS BEARING SEAL OR STAMP OR APPROVAL FROM THE FIRE PREVENTION BUREAU AND THE OWNERS/TENANTS INSURANCE UNDERWRITER, IF REQUIRED. SUBMIT ONE (1) REPRODUCIBLE SEPIA AND THREE (3) BLUELINE PRINTS OF COMPLETE SHOP DRAWINGS, AND SIX (6) SETS OF MANUFACTURER'S DATA ON DEVICES AND (4) SETS OF CALCULATIONS. C. CONTRACTOR SHALL SUBMIT COMPLETE PACKAGES. PARTIAL SUBMITTALS SHALL BE AVOIDED. D. FIRE PROTECTION WORK, INCLUDING ORDERING OF MATERIALS, SHALL NOT BE DONE UNTIL AFTER REQUIRED APPROVALS HAVE BEEN OBTAINED. E. PREPARE SHOP DRAWINGS AT MINIMUM SCALE OF 1/8"=1'-0" FOR PLANS, AND 1/4"=1'-0" FOR DETAILS. SHOW ALL PIPING, SPRINKLERS, HANGERS, FLEXIBLE COUPLINGS, ROOF CONSTRUCTION AND OCCUPANCY OF EACH AREA, INCLUDING CEILING AND ROOF HEIGHTS AS REQUIRED BY NFPA-13. WHEN WELDING IS PLANNED, SHOP DRAWINGS SHALL INDICATE THE SECTIONS TO BE SHOP WELDED AND THE TYPE OF WELDED FITTINGS TO BE USED. F. INSTALLATION SHALL BE BASED ON THE LATEST ARCHITECTURAL, STRUCTURAL, HEATING AND VENTILATING, PLUMBING AND ELECTRICAL DRAWINGS. G. SPRINKLER SYSTEM CONTROLS, VALVING DEVICES, PIPE ROUTING, SPRINKLER HEAD LOCATIONS AND SPACING IF SHOWN ARE A CRITERIA FOR CONTRACTOR TO PREPARE FINAL SHOP DRAWINGS. FIRE PROTECTION CONTRACTOR SHALL FIELD VERIFY EXACT REQUIREMENTS FOR BUILDING REGARDING PIPE SIZES, ADEQUATE PRESSURES, SERVICE LOCATIONS, ZONING AND SUBMIT SHOP DRAWING TO THE AUTHORITIES FOR APPROVAL PRIOR TO FABRICATION OR INSTALLATION OF FIRE PROTECTION WATER SERVICE AND SYSTEMS. 1.05 AS-BUILT DRAWINGS A. MAINTAIN AT THE SITE AN UP-TO-DATE MARKED SET OF AS-BUILT DRAWINGS, WHICH SHALL BE CORRECTED AND DELIVERED TO THE ARCHITECT UPON COMPLETION OF THE WORK. B. FURNISH THE ARCHITECT WITH ONE (1) REPRODUCIBLE SEPIA PRINT OF EACH APPROVED SHOP DRAWINGS, REVISED TO SHOW AS-BUILT CONDITIONS. 1.06 VALVE DIAGRAM AND OPERATING INSTRUCTIONS A. AT THE COMPLETION OF THE WORK, PROVIDE A SMALL SCALE PLAN OF EACH BUILDING SYSTEM INDICATING THE LOCATIONS OF ALL CONTROL VALVES, LOW POINT DRAINS, AND INSPECTORS TESTS. THE PLANS SHALL BE NEATLY DRAWN AND COLOR CODED TO INDICATE THE PORTION OF THE BUILDING PROTECTED BY EACH SYSTEM, FRAMED UNDER GLASS AND PERMANENTLY MOUNTED ON THE WALL ADJACENT TO THE SPRINKLER RISER VALVES. B. FURNISH ONE (1) COPY OF NFPA-25, "INSPECTION, TESTING AND MAINTENANCE OF WATER BASE PROTECTION SYSTEMS", AND BOUND SET(S) OF PRINTED OPERATING AND MAINTENANCE INSTRUCTIONS TO THE OWNER, AND ADEQUATELY INSTRUCT THE OWNERS MAINTENANCE PERSONNEL, IN PROPER OPERATION AND TEST PROCEDURES OF ALL FIRE PROTECTION COMPONENTS PROVIDED. 1.07 CHANGES A. MAKE NO CHANGES IN INSTALLATION FROM LAYOUT AS SHOWN ON DRAWINGS, UNLESS CHANGE IS SPECIFICALLY APPROVED BY THE ARCHITECT. THIS DOES NOT INCLUDE MINOR REVISIONS FOR THE PURPOSE OF COORDINATION. B. ANY CHANGES MADE, OTHER THAN AS ABOVE STATED, ARE AT THE CONTRACTORS OWN EXPENSE AND RESPONSIBILITY. 1.08 LEAK DAMAGE A. THE CONTRACTOR SHALL BE RESPONSIBLE DURING THE INSTALLATION AND TESTING PERIODS OF THE SPRINKLER SYSTEM FOR ANY DAMAGE TO THE WORK OF OTHERS, TO THE BUILDING, ITS CONTENTS, ETC. CAUSED BY LEAKS IN ANY EQUIPMENT, BY UNPLUGGED OR DISCONNECTED PIPES, FITTINGS, ETC. OR BY OVERFLOW, AND SHALL PAY FOR THE NECESSARY REPLACEMENTS OR REPAIRS TO WORK OF OTHERS, DAMAGED BY SUCH LEAKAGE. 1.09 PERMITS AND FEES A. THE CONTRACTOR SHALL PAY FOR ALL PERMITS, FEES AND CHARGES REQUIRED FOR THIS WORK. PART 2 - PRODUCTS 2.01 GENERAL A. THE NAMING OF MANUFACTURERS IN THE SPECIFICATIONS SHALL NOT BE CONSTRUED AS ELIMINATING THE MATERIALS, PRODUCTS OR SERVICES OF OTHER MANUFACTURERS AND SUPPLIERS HAVING APPROVED EQUIVALENT ITEMS. B. 'LISTED' SHALL REFER TO MATERIALS OR EQUIPMENT INCLUDED IN A LIST PUBLISHED BY A NATIONALLY RECOGNIZED TESTING LABORATORY THAT MAINTAINS PERIODIC INSPECTION OF PRODUCTION OF LISTED EQUIPMENT OR MATERIALS, AND WHOSE LISTING STATES EITHER THAT THE EQUIPMENT OR MATERIAL MEETS NATIONALLY RECOGNIZED STANDARD OR HAS BEEN TESTED AND FOUND SUITABLE FOR USE IN A SPECIFIED MANNER. 2.02 SPRINKLERS A. SPRINKLERS FOR THE PROPOSED EQUIPMENT SHALL BE NEW AND OF THE LISTED AUTOMATIC, CONCEALED WITH WHITE COVER PLATE OR APPROVED EQUAL, AND SHALL BE DISTRIBUTED THROUGHOUT THE BUILDING, APPROXIMATE NUMBER OF SPRINKLERS AND TYPE SHOWN ON CONTRACTORS SHOP DRAWINGS. IF THE NUMBER OF SPRINKLERS INDICATED IN THE SPRINKLER COUNT SUMMARY DIFFERS FROM ACTUAL COUNT ON PLANS, THE ACTUAL COUNT SHALL BE PROVIDED. B. INSTALL SPRINKLERS OF PROPER DEGREE RATING WHEREVER NECESSARY TO MEET REQUIREMENTS OF NFPA-13. 2.03 HOSE THREADS A. HOSE THREADS FOR HYDRANTS AND FIRE DEPARTMENT SIAMSESE CONNECTION SHALL MATCH THOSE OF THE LOCAL FIRE DEPARTMENT. 2.04 VALVES AND DEVICES A. ALL SPRINKLER CONTROL VALVES, DEVICES, CHECK VALVES, ALARM VALVES, ETC. SHALL BE OF THE APPROVED AND LISTED TYPE. 2.05 PIPING A. PIPE SHALL BE SCHEDULE 40, ASTM 53, BLACK STEEL WITH 125 & 250 WORKING PRESSURE CAST IRON FITTINGS, ANSI B16.4 OR 150 & 300 WORKING PRESSURE MALLEABLE IRON FITTINGS, ANSI B16.3. FITTINGS 2" & SMALLER SHALL BE STANDARD WEIGHT AND 2-1/2" & LARGER SHALL BE EXTRA HEAVY. CAST IRON FLANGED FITTINGS, ANSI B16.1, MAY BE USED FOR PIPING 3" & LARGER. NO THINWALL TYPE PIPE WILL BE PERMITTED. B. SCHEDULE 10, ASTM 135 BLACK STEEL THINWALL PIPE WITH MECHANICAL PIPE COUPLING AND ROLL-GROOVED JOINTS MAY BE USED FOR 2-1/2" & LARGER PIPING. NO "XL" TYPE PIPE WILL BE PERMITTED. C. PIPING SHALL BE JOINTED BY THREADED AND/OR GROOVED JOINT MECHANICAL PIPE COUPLINGS. GROOVED JOINT COUPLINGS SHALL BE FOR 2-1/2" & LARGER ONLY AND SHALL BE EQUAL TO VICTAULIC STYLE 75 OR 77. NO THREADED THINWALL PIPE IS PERMITTED. WELDING WILL BE ACCEPTED WHEN IN ACCORDANCE WITH THE STANDARDS OF NFPA, AND WHERE APPROVED BY AUTHORITIES HAVING JURISDICTION; NO FIELD WELDING IS PERMITTED.</div>	<div>PART 3 - EXECUTION 3.01 HYDRANT FLOW TEST A. HYDRANT FLOW TEST EXISTING SITE FIRE LOOP PIPING PRIOR TO MAKING ANY CONNECTIONS. NOTIFY ARCHITECT IF FLOW TEST IS UNSUCCESSFUL. SCHEDULE TESTING TO ALLOW SUFFICIENT TIME FOR REPAIRS TO BE MADE OR IF FIRE PUMP IS REQUIRED TO SUPPLEMENT THE REQUIRED PRESSURE AND DESIGN FLOW RATE. 3.02 TESTING OVERHEAD PIPE A. TEST ALL SPRINKLER PIPING IN ACCORDANCE WITH NFPA-13 REQUIREMENTS. NOTIFY ARCHITECT'S REPRESENTATIVE, OWNER'S REPRESENTATIVE AND LOCAL FIRE DEPARTMENT, 72 HOURS IN ADVANCE REGARDING TIME AND DATE OF ALL TESTS. OWNER SHALL ALSO ARRANGE WITH INSURING AGENCY AUTHORITIES FOR THEIR REPRESENTATIVE TO BE PRESENT. 3.03 DRAINS A. PROVIDE ALL MAIN AND AUXILIARY DRAINS WHERE NECESSARY. PROVIDE MEANS FOR DRAINING ENTIRE SYSTEMS, DOWN STREAM OF ALL SHUT-OFF VALVES AND ALL LOW POINTS. 3.04 CEILING AND WALL PLATES A. INSTALL CHROME FINISHED CEILING AND WALL PLATES WHEREVER EXPOSED SPRINKLER PIPING PASSES THROUGH CEILINGS AND WALLS. 3.05 SLEEVES A. SET SLEEVES IN PLACE FOR ALL PIPES PASSING THROUGH FLOOR AND WALL OPENINGS. 3.06 WELDING A. NO FIELD WELDING OF SPRINKLER PIPING SHALL BE PERMITTED. B. JOIN ALL INSIDE PIPING BY MEANS OF SCREWED, FLANGED OR FLEXIBLE GASKETED JOINTS OR OTHER ACCEPTABLE FITTINGS. 3.07 INSPECTOR'S TEST A. PROVIDE TEST CONNECTIONS AT MOST REMOTE POINT OF MAIN PORTION OF EACH SPRINKLER SYSTEM WITH 1-INCH PIPE AND VALVE. TEST PIPE SHALL BE CONNECTED TO SPRINKLER PIPE AT LEAST 1-1/4" DIAMETER AND SHALL DISCHARGE OUTSIDE BUILDING OR ADEQUATE FLOOR DRAIN THROUGH 1/2" SMOOTH BORE BRASS OUTLET WHERE IT CAN BE EASILY SEEN. B. CONSULT WITH ARCHITECT'S REPRESENTATIVE AT JOB FOR EXACT LOCATION OF INSPECTORS TEST CONNECTIONS. 3.08 EXTRA SPRINKLERS A. PROVIDE TWO SPARE SPRINKLER CABINETS COMPLETE WITH SPRINKLERS OF ASSORTED TEMPERATURE RATINGS OF THE TYPE NECESSARY AND IN USE THROUGHOUT THE INSTALLATION. EACH CABINET SHALL BE EQUIPPED WITH TWELVE (12) SPRINKLERS AND A SPECIAL SPRINKLER WRENCH FOR EACH TYPE OF SPRINKLER FURNISHED. B. INSTALL SPRINKLER CABINETS ADJACENT TO THE RISER VALVES AND CONFER WITH ARCHITECT'S REPRESENTATIVE FOR EXACT LOCATION OF CABINET. 3.09 SPECIALTY DEVICES A. INSTALLATION OF ALL SPECIALTY DEVICES SHALL BE IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS. WHERE THE INSTALLATION OF THOSE DEVICES REQUIRE USE OF A TORQUE WRENCH OR OTHER APPLIANCE, THE CONTRACTOR SHALL CERTIFY THAT THE MANUFACTURERS INSTRUCTIONS HAVE BEEN COMPLIED WITH.</div>
<div>DICKERHOOF CONSTRUCTION P.O. BOX 1800 CORVALLIS, OR 97339</div>	<div>LANDLORD WORK FOR FUTURE ULTA #1619 2870S, 6TH ST. KLAMATH FALLS, OR 97603</div>
<div>Revisions △ ISSUE FOR TENANT REVIEW 08/15/19 △ ISSUE FOR PERMIT 08/15/19 △ △ △ △ △ △ △</div>	<div>PLUMBING SPECIFICATIONS</div>
<div> Signature _____ Date 08/15/2019 Expiration Date 06/30/2020 I HEREBY CERTIFY THAT THESE PLANS HAVE BEEN PREPARED UNDER MY SUPERVISION AND THAT TO THE BEST OF MY KNOWLEDGE, THEY COMPLY WITH ALL RULES, REGULATIONS AND ORDINANCES OF KLAMATH FALLS, OR RELATING TO STRUCTURES AND BUILDINGS. ENGINEER Drawn By QE Checked By DH Scale NO SCALE Date 08/15/19 Job No. Sheet No. P-5</div>	