


A

B

C

D


E




- VERTICAL COMPRESSION STRUTS**
1. 1'-0" TO 5'-0" USE 1/2" DIAMETER CONDUIT (EMT)
 2. 5'-0" TO 1'-8" USE 3/4" DIAMETER CONDUIT (EMT)
 3. 1'-8" TO 9'-8" USE 1" DIAMETER CONDUIT (EMT)
 4. 9'-8" TO 12'-0" USE SINGLE 1629125-33 METAL STUD (1-5/8" X 20 GA.)
 5. 12'-0" TO 15'-0" USE BACK TO BACK 1629125-33 METAL STUD (2-1/2" X 20 GA.)
 6. ALT: 13'-6" USE SINGLE 2509125-33 METAL STUD (2-1/2" X 20 GA.)
 7. ALT: 15'-0" USE BACK TO BACK 2509125-33 METAL STUDS (2-1/2" X 20 GA.)

NOTE: INSTALL PER ASTM C 635 (IBC / 25 / #2), ASTM C 636 AND UBC STANDARD 25-2.


- AT LIGHT FIXTURES:**
1. NO. 12 GAUGE HANGER WIRE SHALL BE BE ATTACHED TO THE GRID MEMBER WITHIN 3" OF EACH CORNER OF FIXTURE
 2. EACH LIGHT FIXTURE TO HAVE TWO (2) NO. 12 GAUGE HANGER WIRES ATTACHED AT OPPOSITE CORNERS OF THE FIXTURE HOUSING TO THE STRUCTURE ABOVE




B3 SUSPENDED CEILING LIGHT FIXTURE DETAIL
SCALE: 3" = 1'-0"



C3 SUSPENDED CEILING EDGE DETAIL
SCALE: 3" = 1'-0"



E1 ENLARGED PLAN @ BATHING / GROOMING
SCALE: 3/16" = 1'-0"

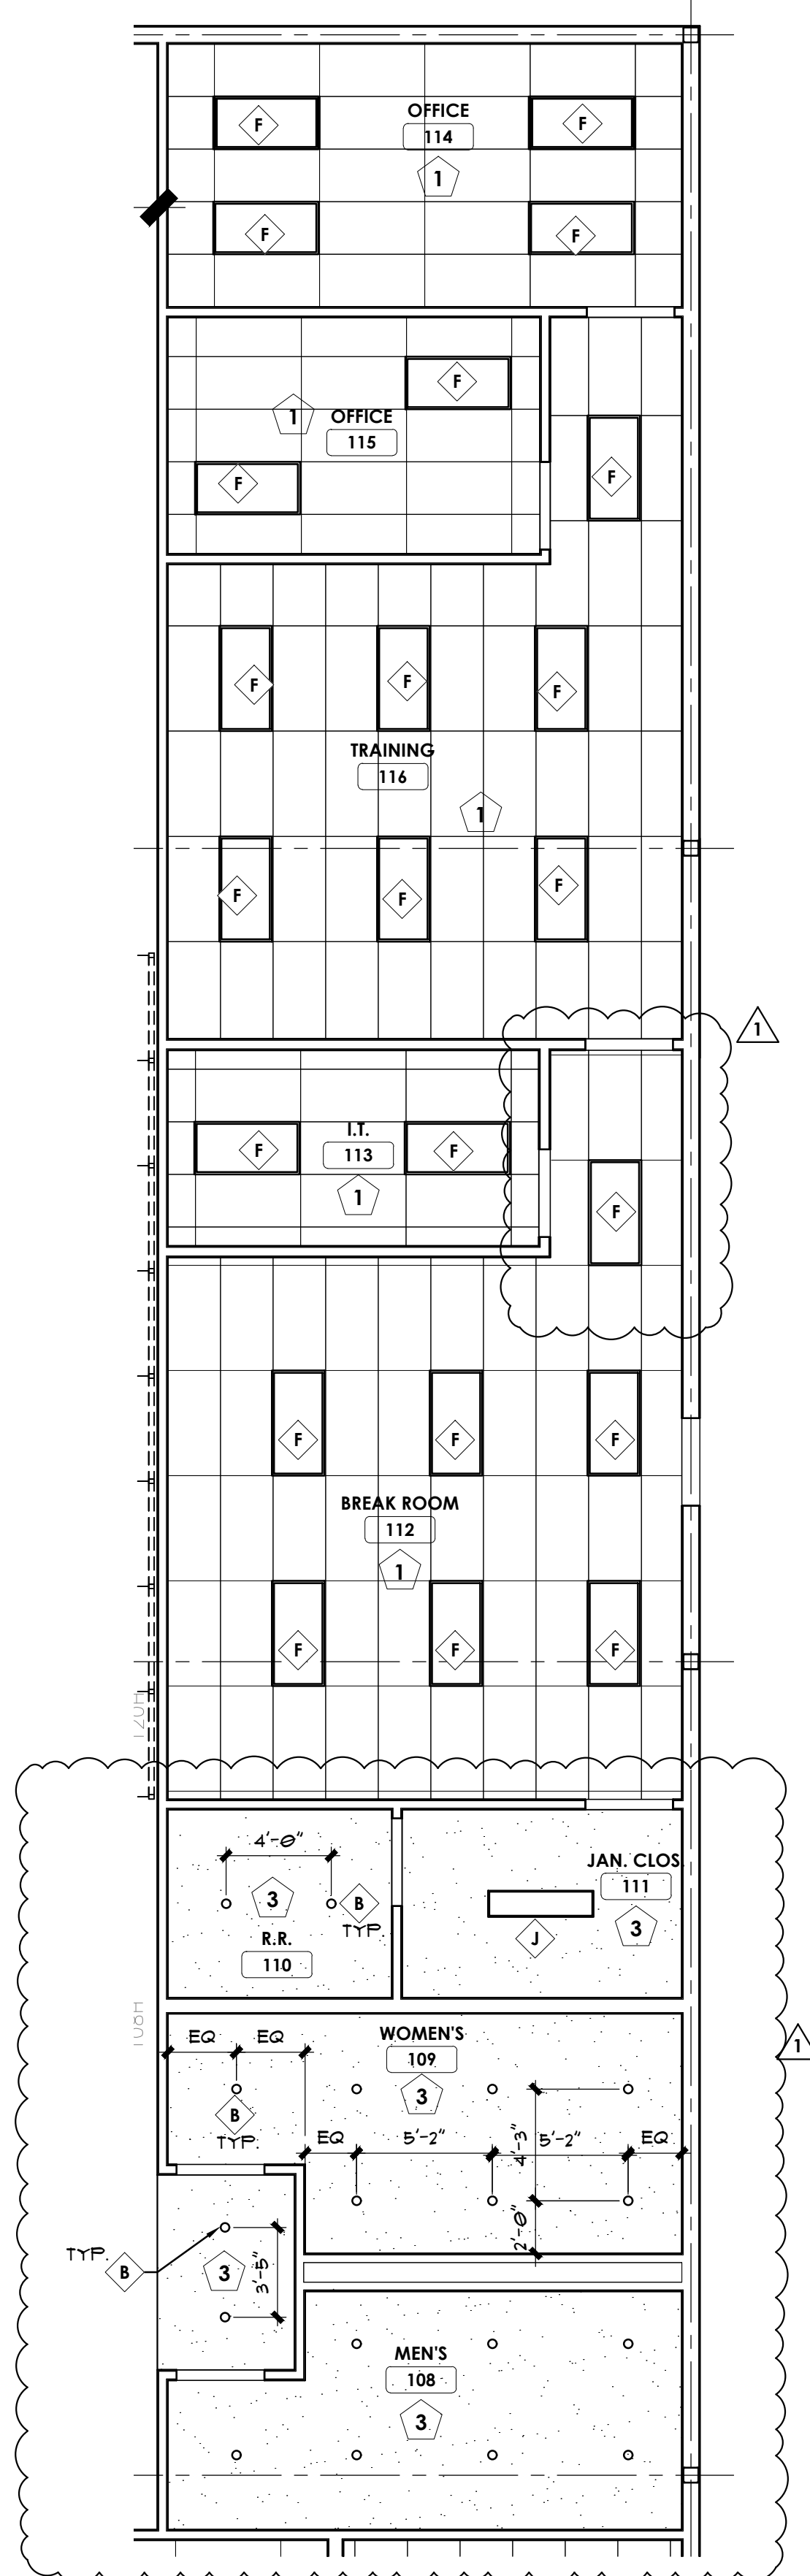

E5 ENLARGED PLAN @ I.T. / OFFICES
SCALE: 3/16" = 1'-0"

SHEET NOTES

NEW LIGHTING FIXTURES KEY:

- A** LED FLAT HIGH BAY, 12X24 SUSPENDED (PROVIDE WHITE CORD)
- B** LED RECESSED DOWNLIGHT
- C** LED TRACK LIGHT, SUSPENDED, PROVIDE WATTAGE LIMITER (10'-0" A.F.F.)
- D** LED PENDANT AT WESTERN WEAR
- E** LED PENDANT AT PAINT AREA OVER TABLES
- F** LED 2X4 SURFACE MOUNT PANEL
- G** LIGHT BAR (OFC)
- H** LED COMPASS HIGH BAY PENDANT WITH ACRYLIC REFLECTOR (90362) AND LENS (90363)
- J** LED TUBE 4' WITH TYPE C DRIVER FOR 1/2" 13W/T8 TUBES
- K** LED LIGHT STRIPS: TAPE TO UNDERSIDE OF GONDOLA SHELVEs
- L** LED SCONE IN DRESSING ROOM
- M** EXTERIOR LED LIGHT FIXTURES

CEILING PLAN NOTES:

1. COORDINATE LIGHT FIXTURE LAYOUT WITH TENANTS FINAL FIXTURE PLAN
2. ALL INTERIOR SUSPENDED CEILINGs ARE TO BE 8'-0" A.F.F.
3. PAINT ENTIRE ROOF STRUCTURE. METAL DECK, BEAMS, TRUSSES, CONDUIT, DUCTWORK, ETC. IN SALES FLOOR AREA P-1 (DRY-FALL WHITE)
4. DO NOT ATTACH HANGER WIRE TO BOTTOM CHORD OF TRUSSES
5. TRACK LIGHTS IN CLOTHING PAD TO BE ATTACHED TO UN-STRUT MEMBERS, SUSPENDED FROM THE BOTTOM OF ROOF DECK. TRACK LIGHTS MUST BE STRAIGHT (N-LINE) AND LEVEL
6. COORDINATE INSTALLATION OF LIGHT FIXTURES WITH DUCTWORK, TRAPEZE UNDER DUCTWORK WITH UN-STRUT WHERE REQUIRED TO KEEP LIGHT FIXTURES IN LINE

KEY NOTES

- 1** ACOUSTICAL TILES (ACT-1) TO BE INSTALLED
- 2** WASHABLE ACOUSTICAL TILE (ACT-2) VINYL FACE
- 3** SUSPENDED GYP. BD. CEILING @ 8'-0" AFF